


FIG. 1

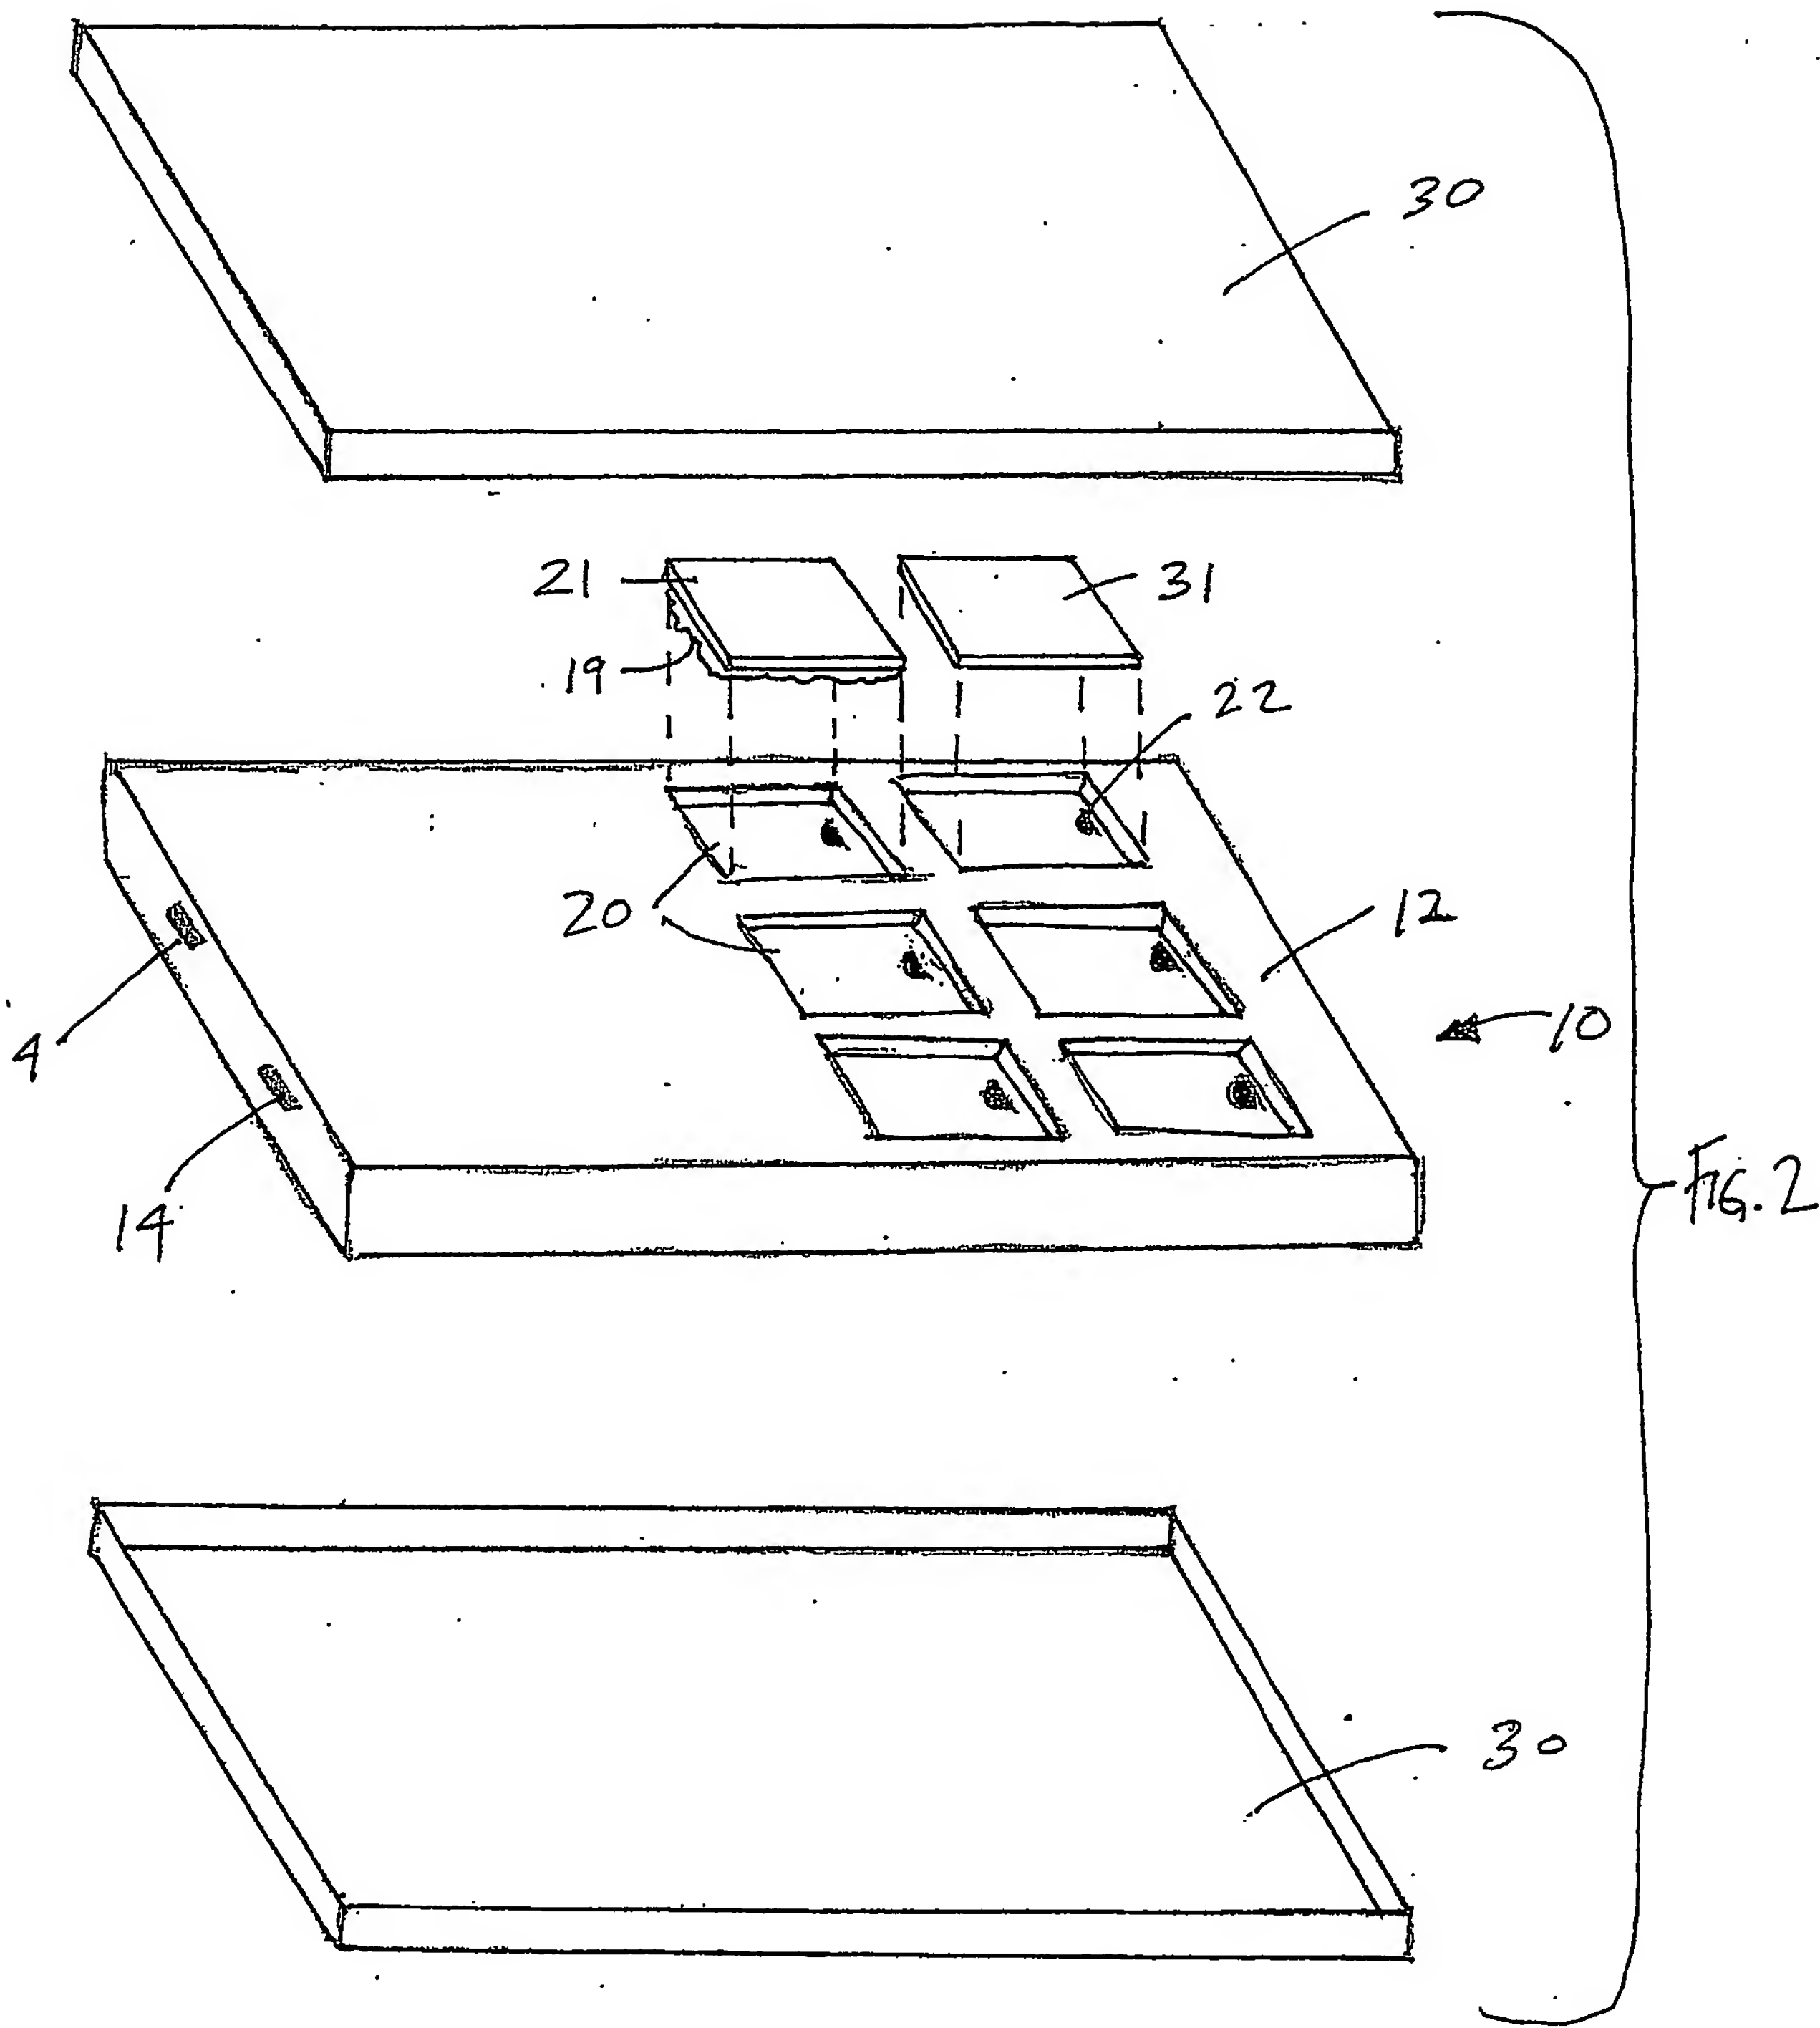

BEST AVAILABLE COPY









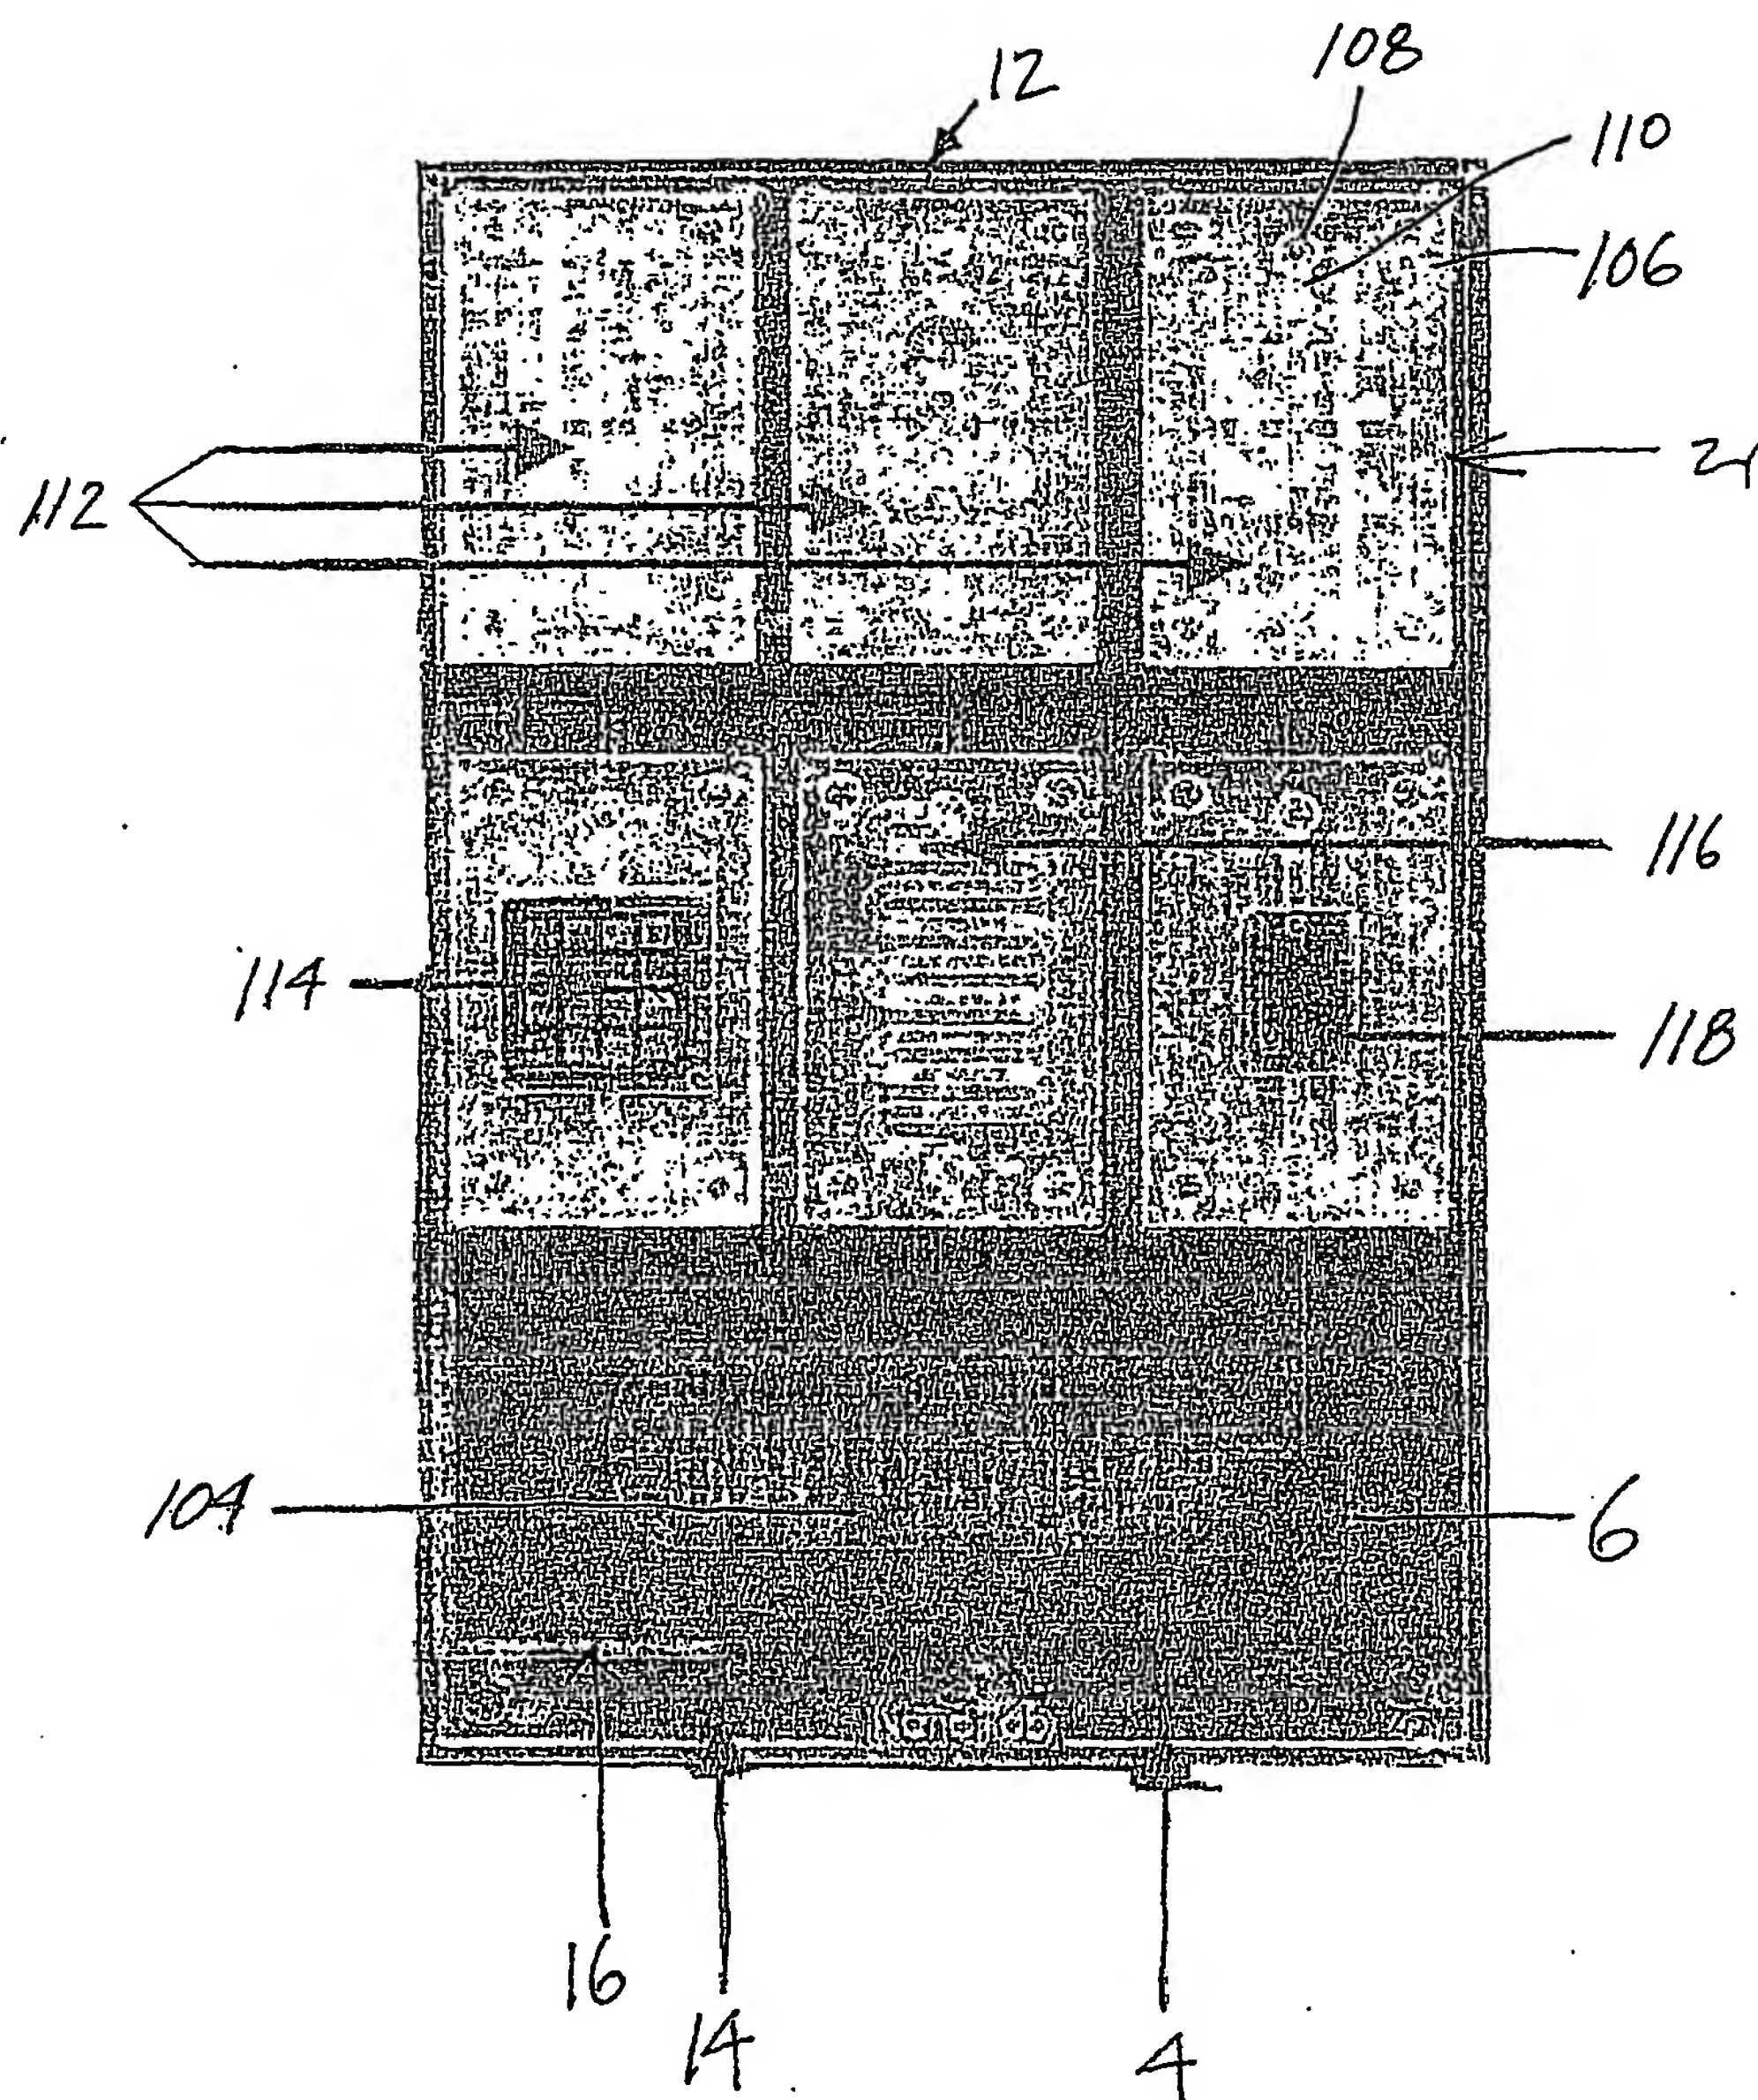


FIG. 3

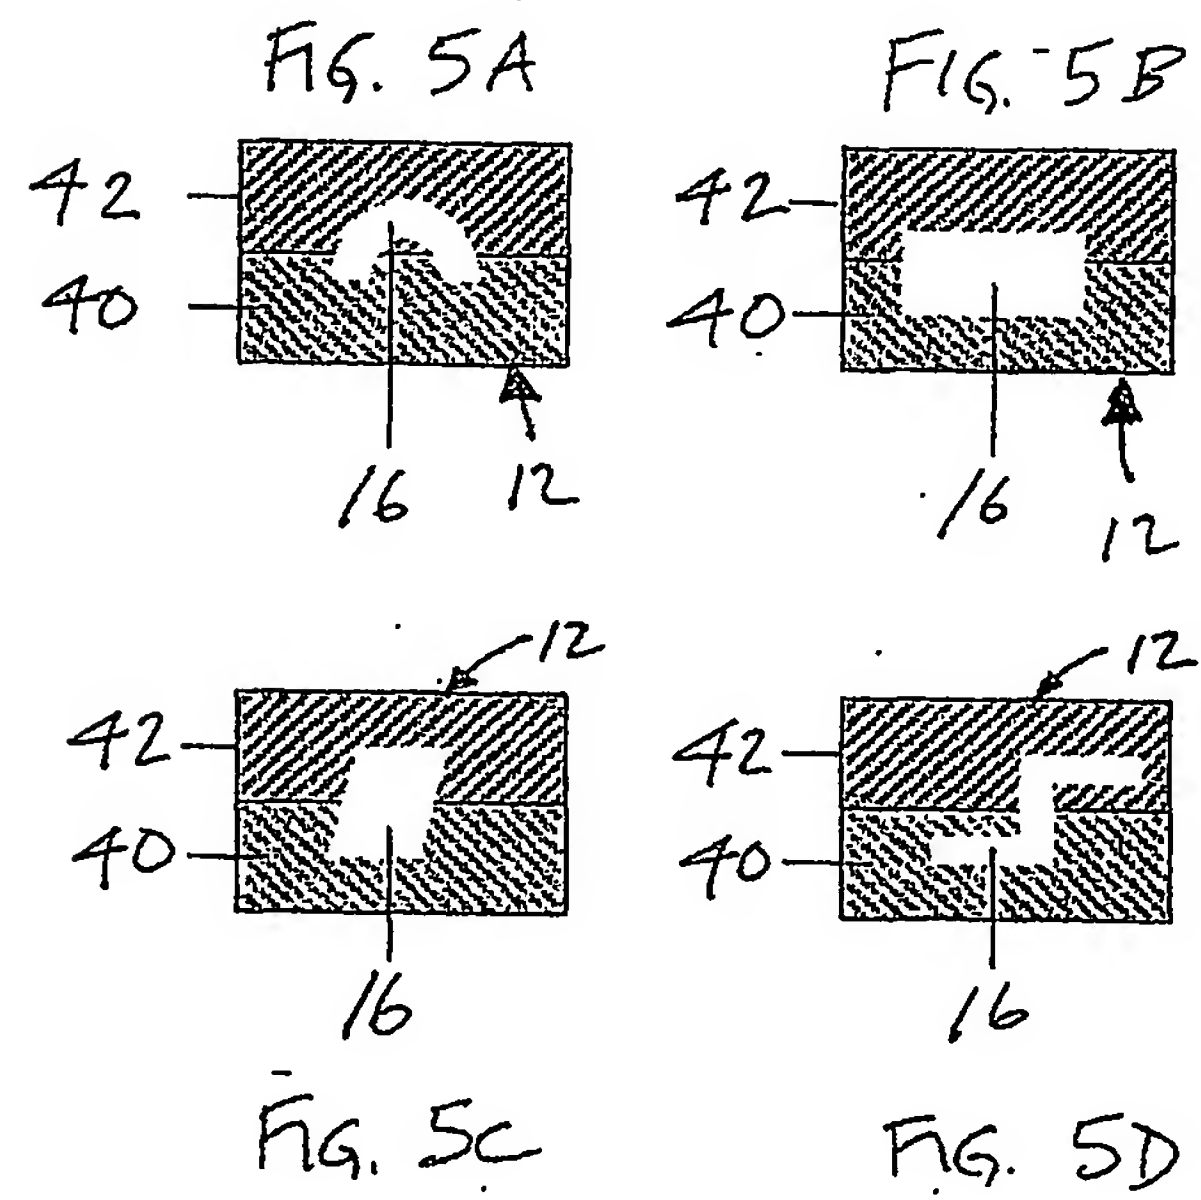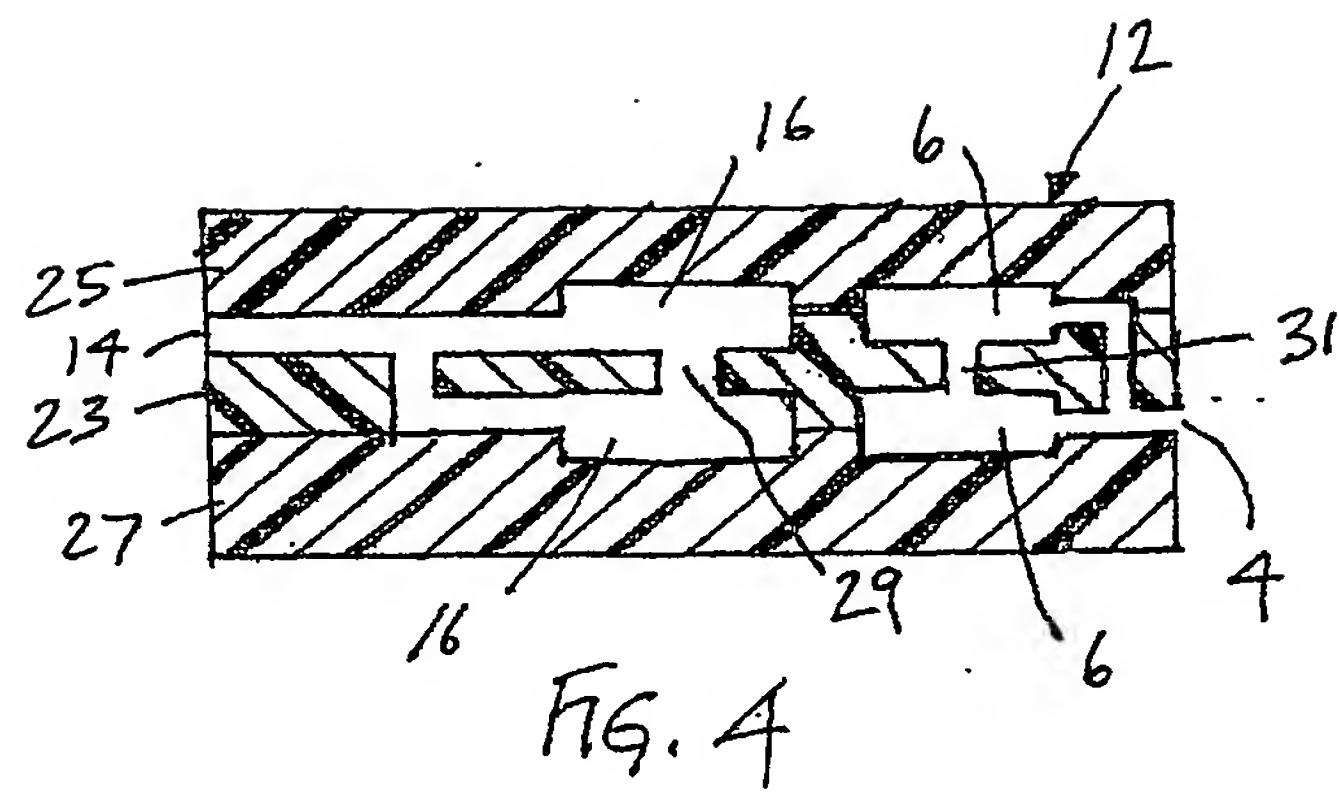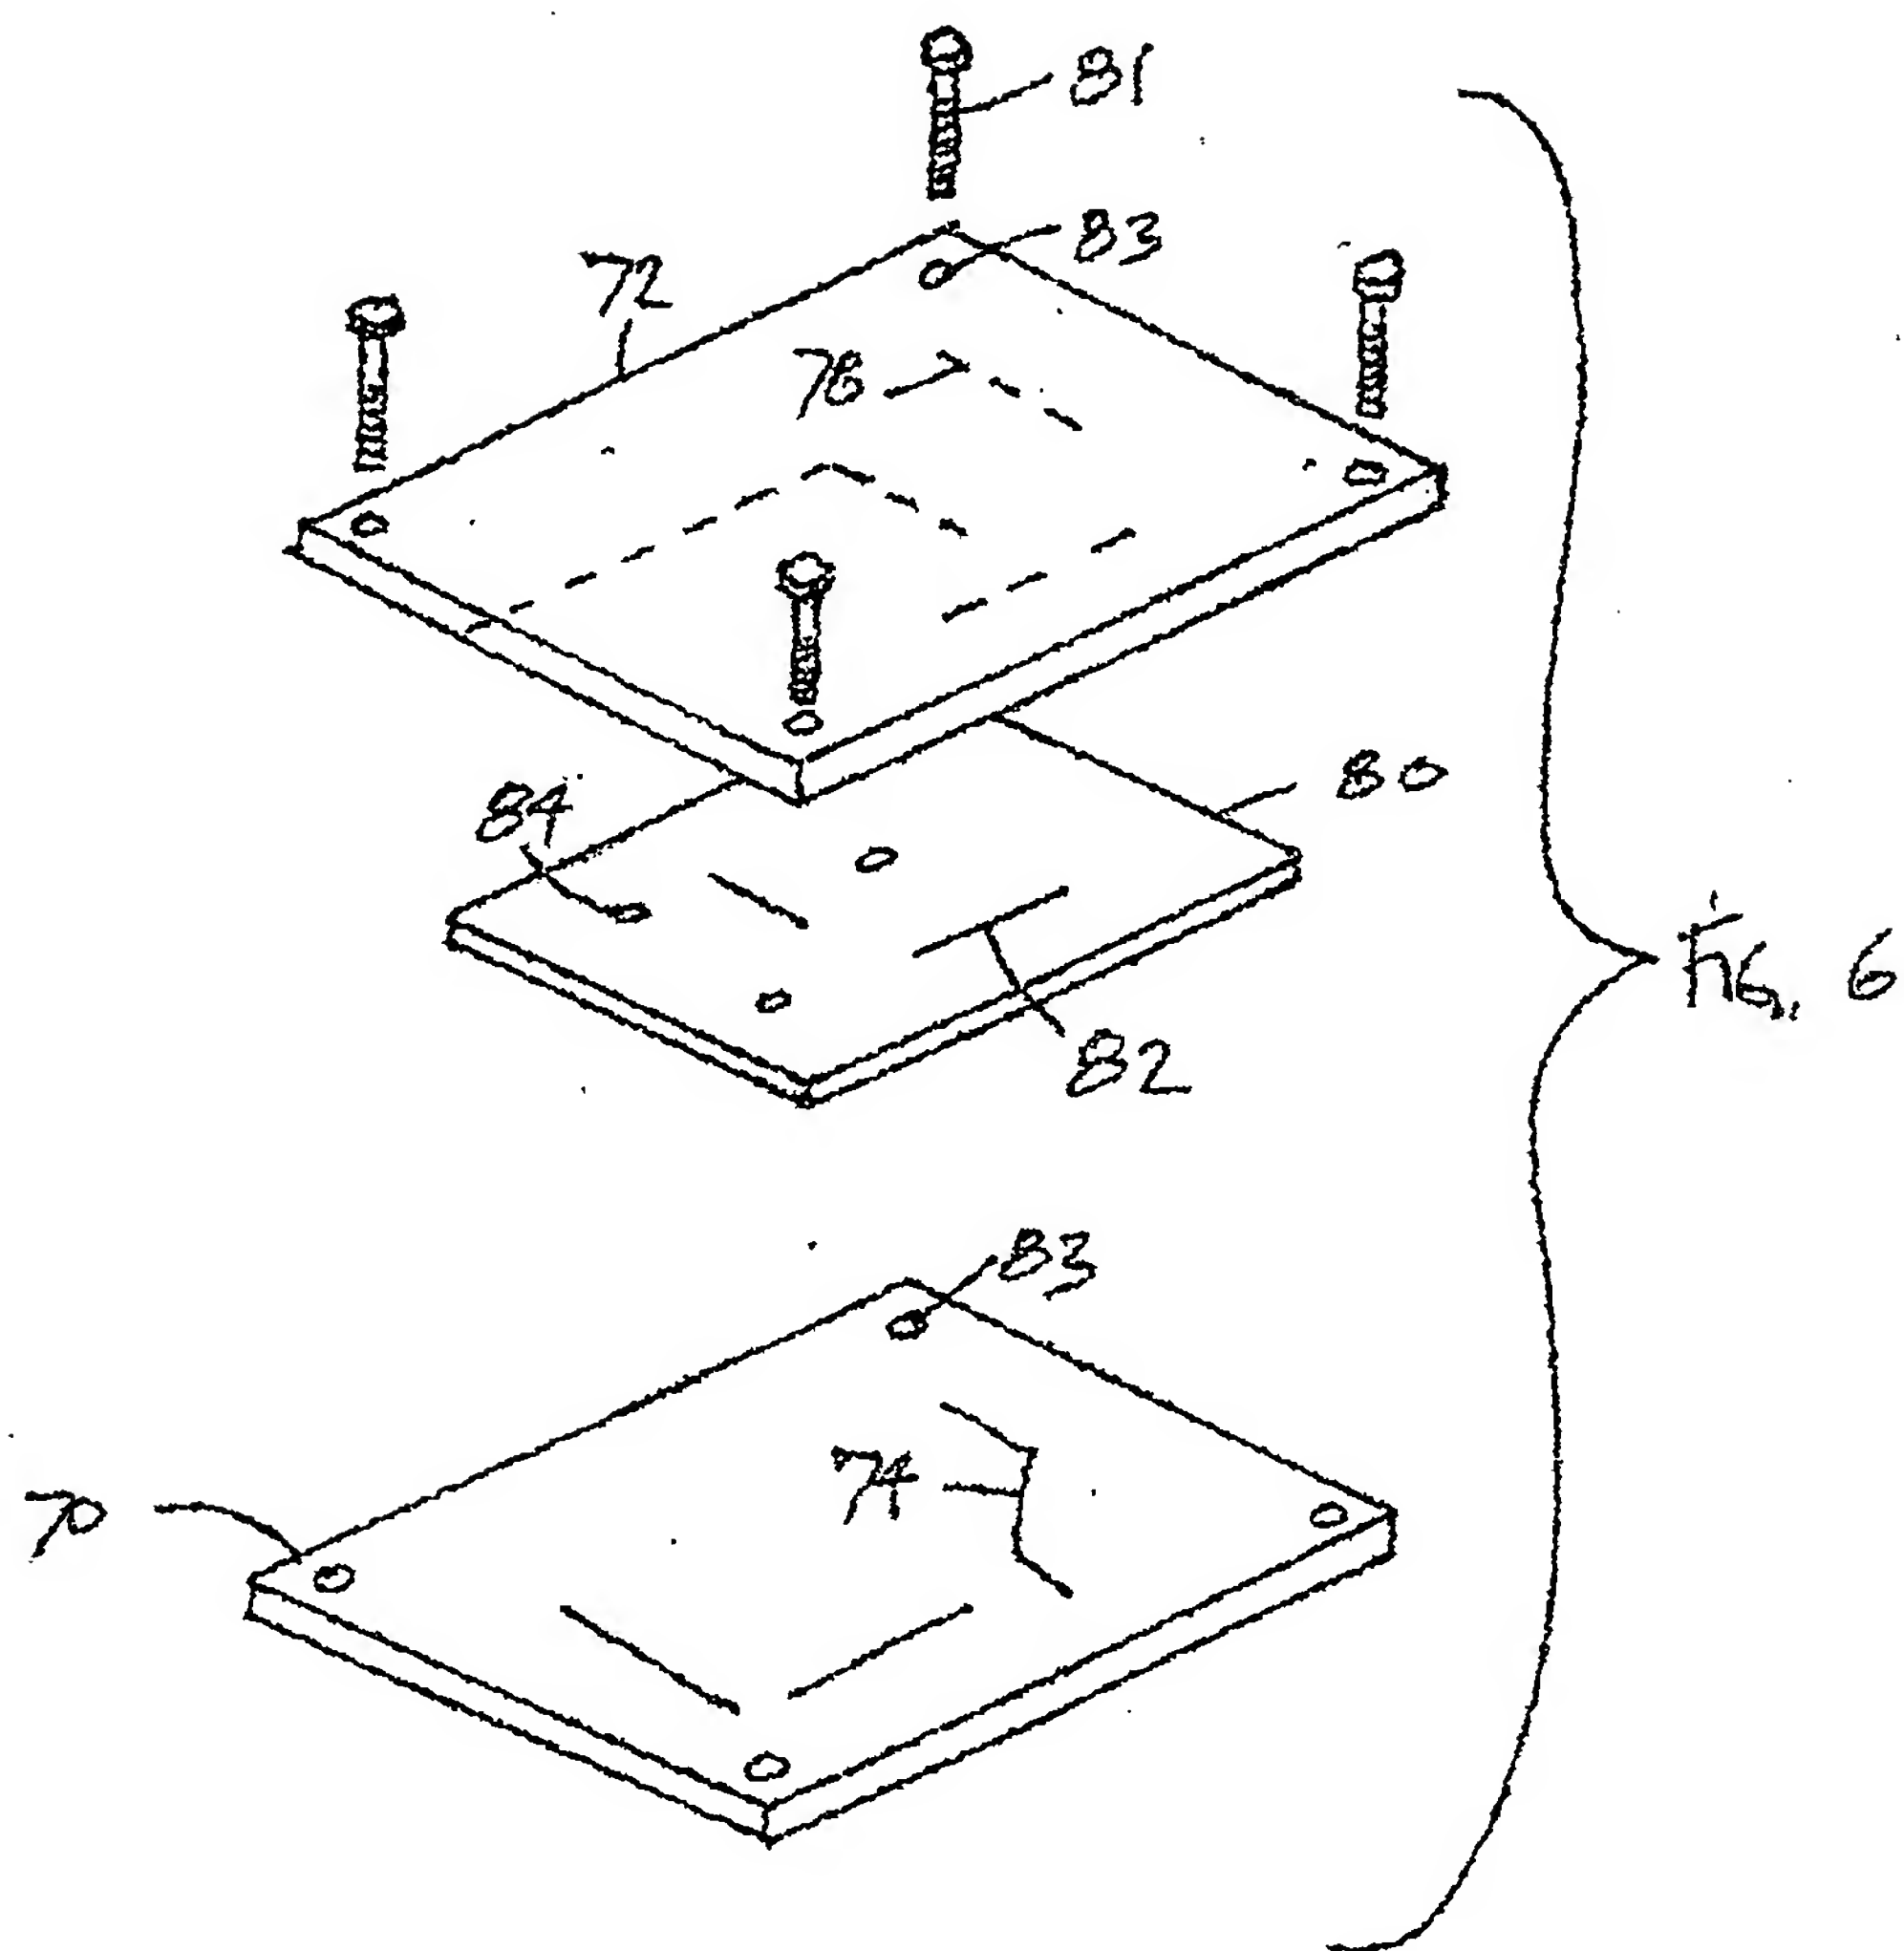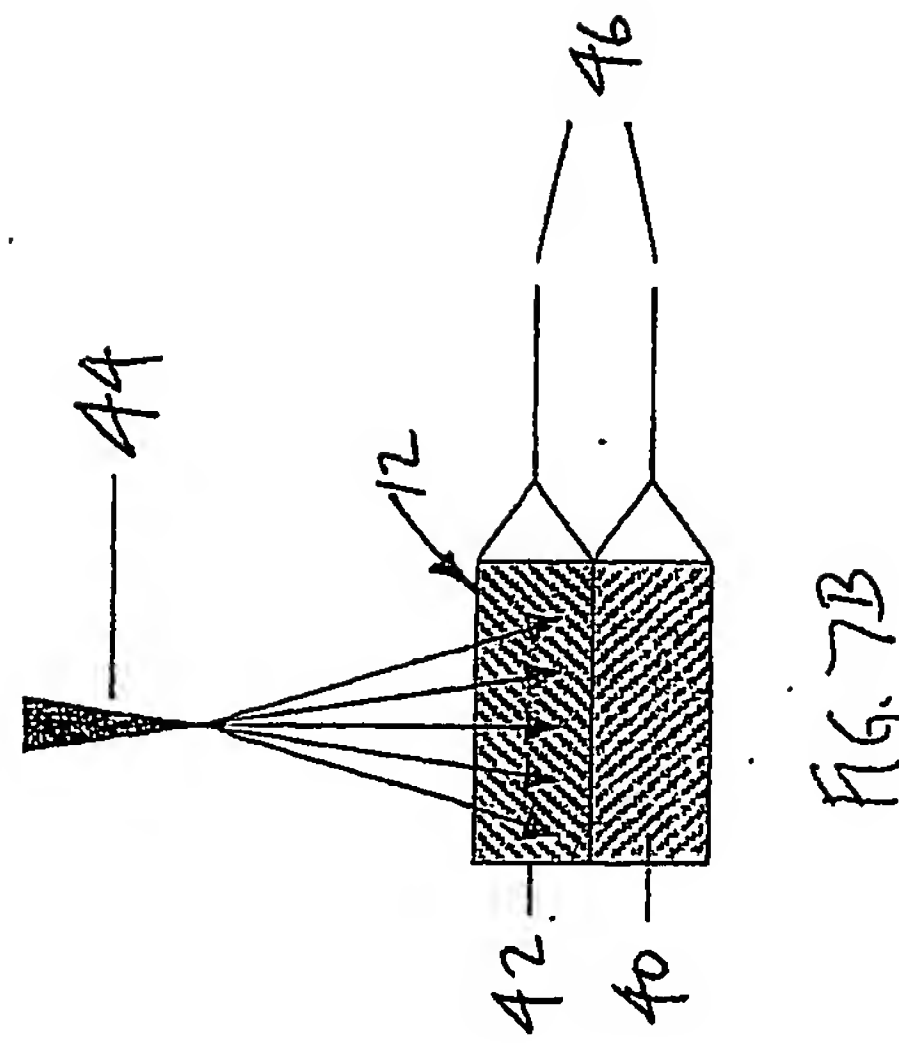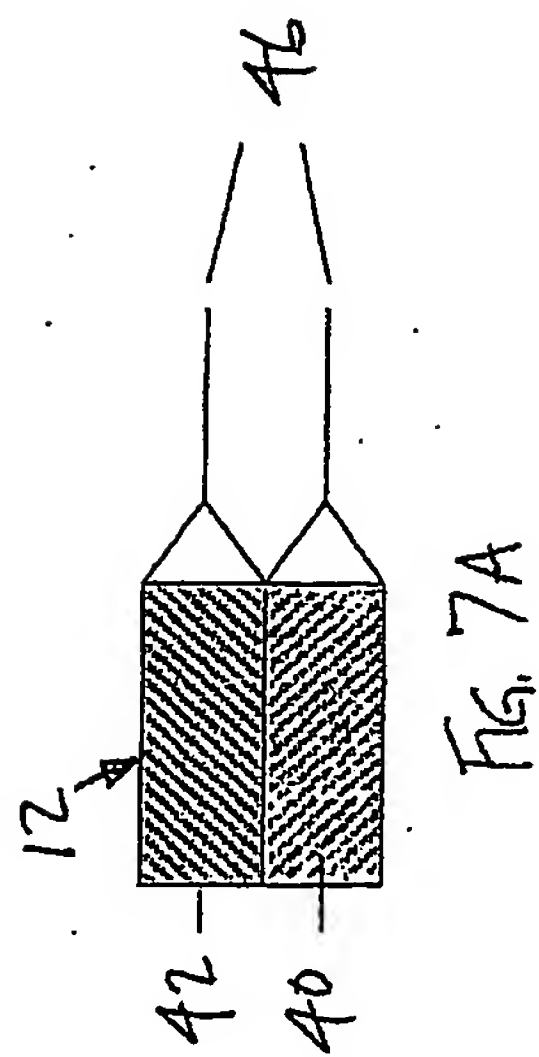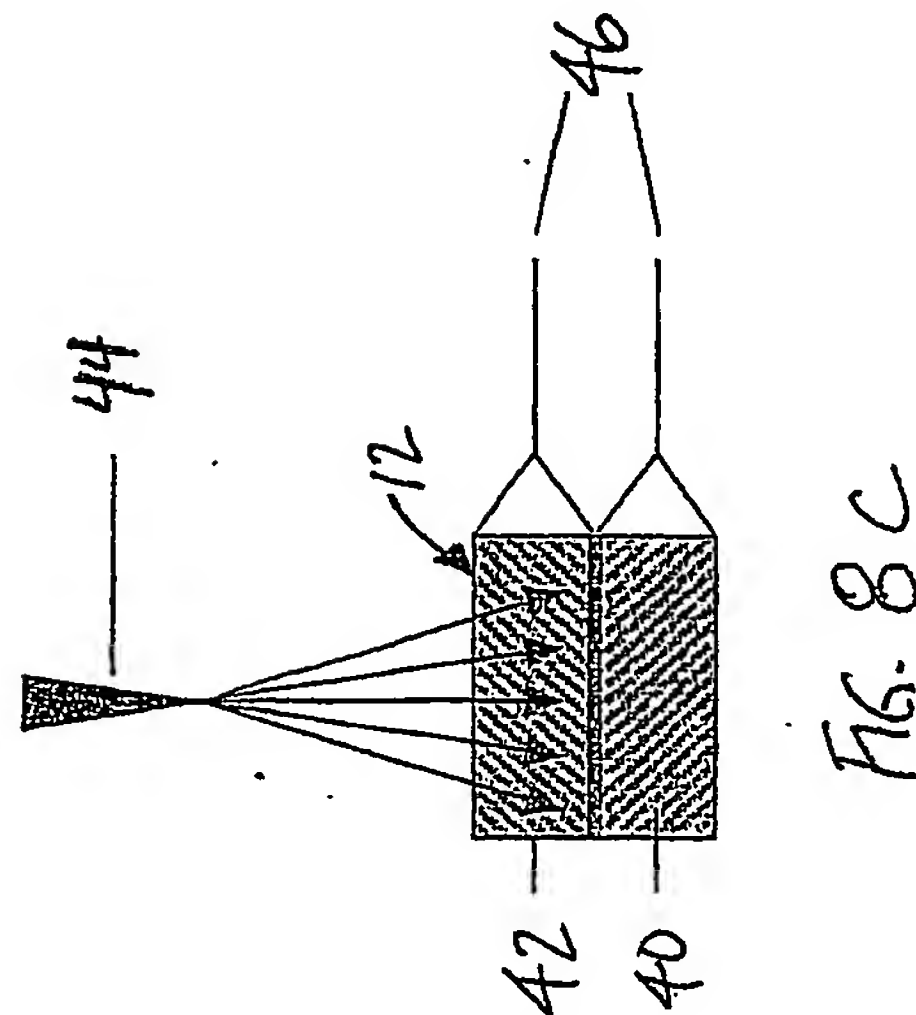


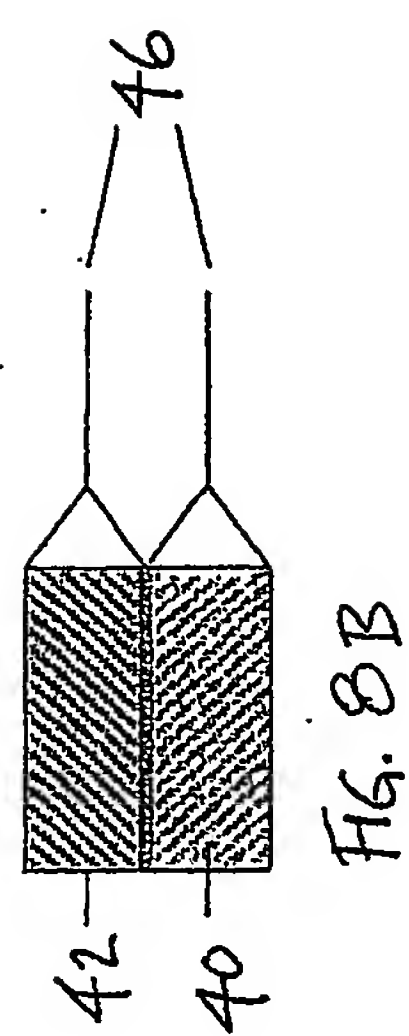



BEST AVAILABLE COPY

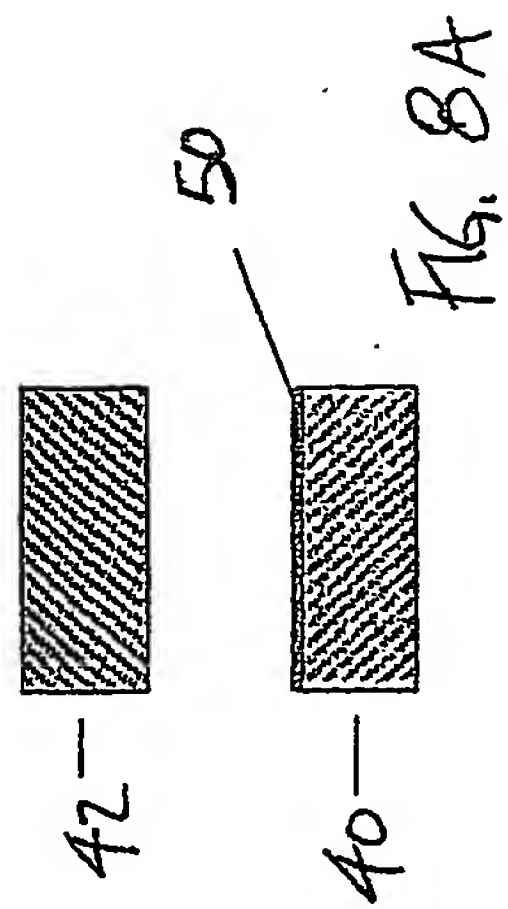



BEST AVAILABLE COPY

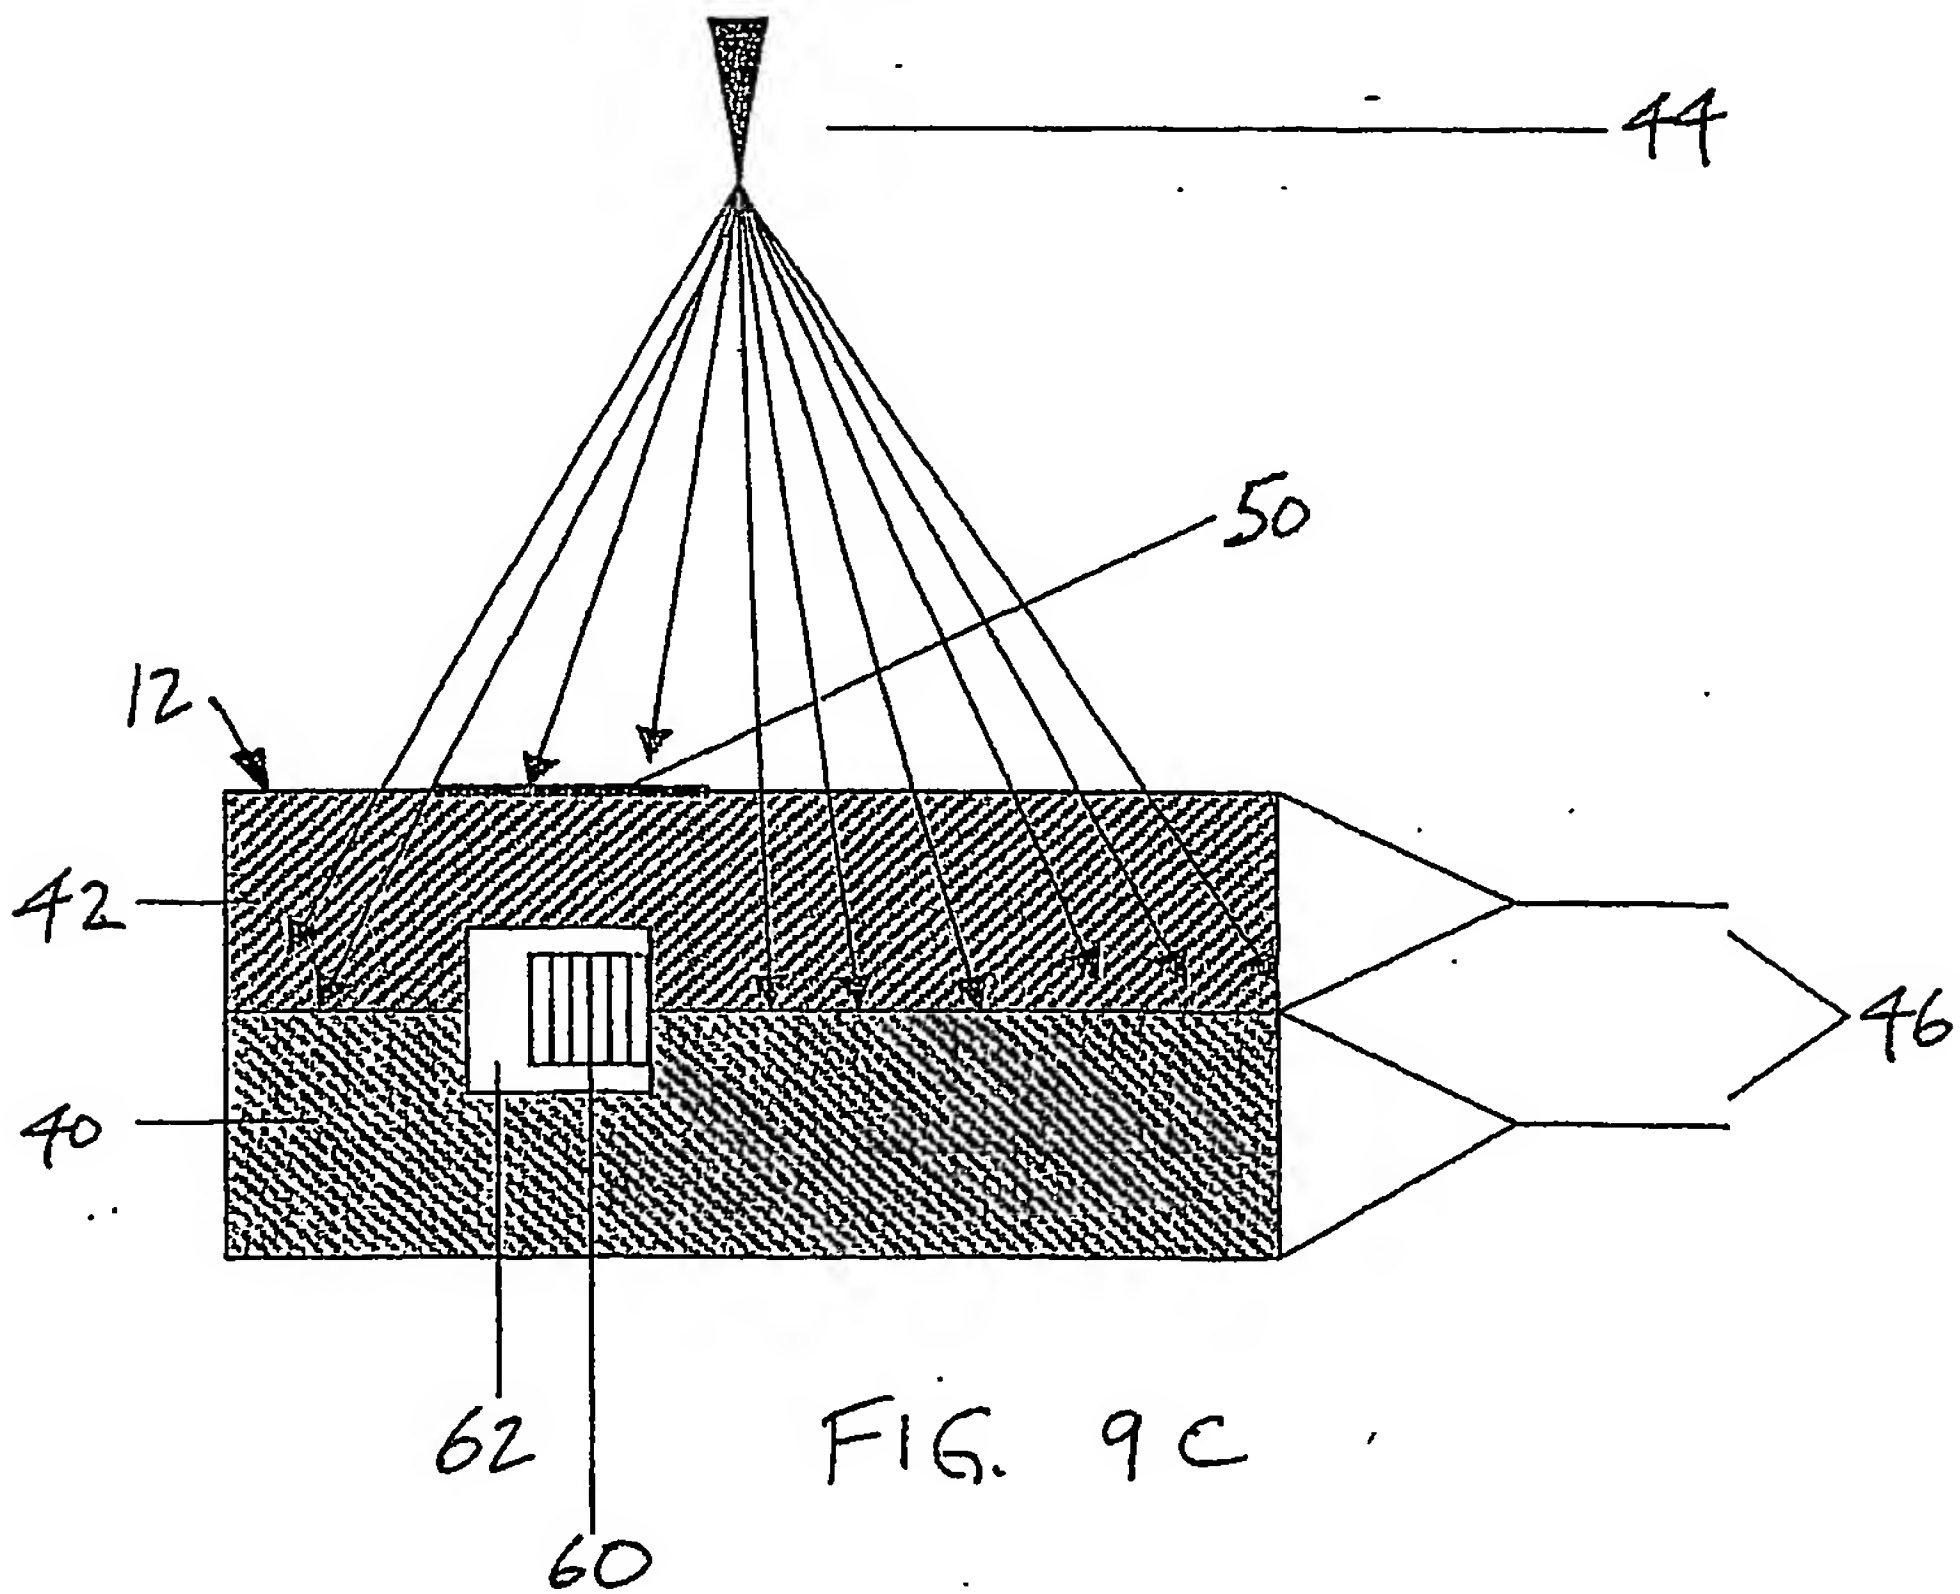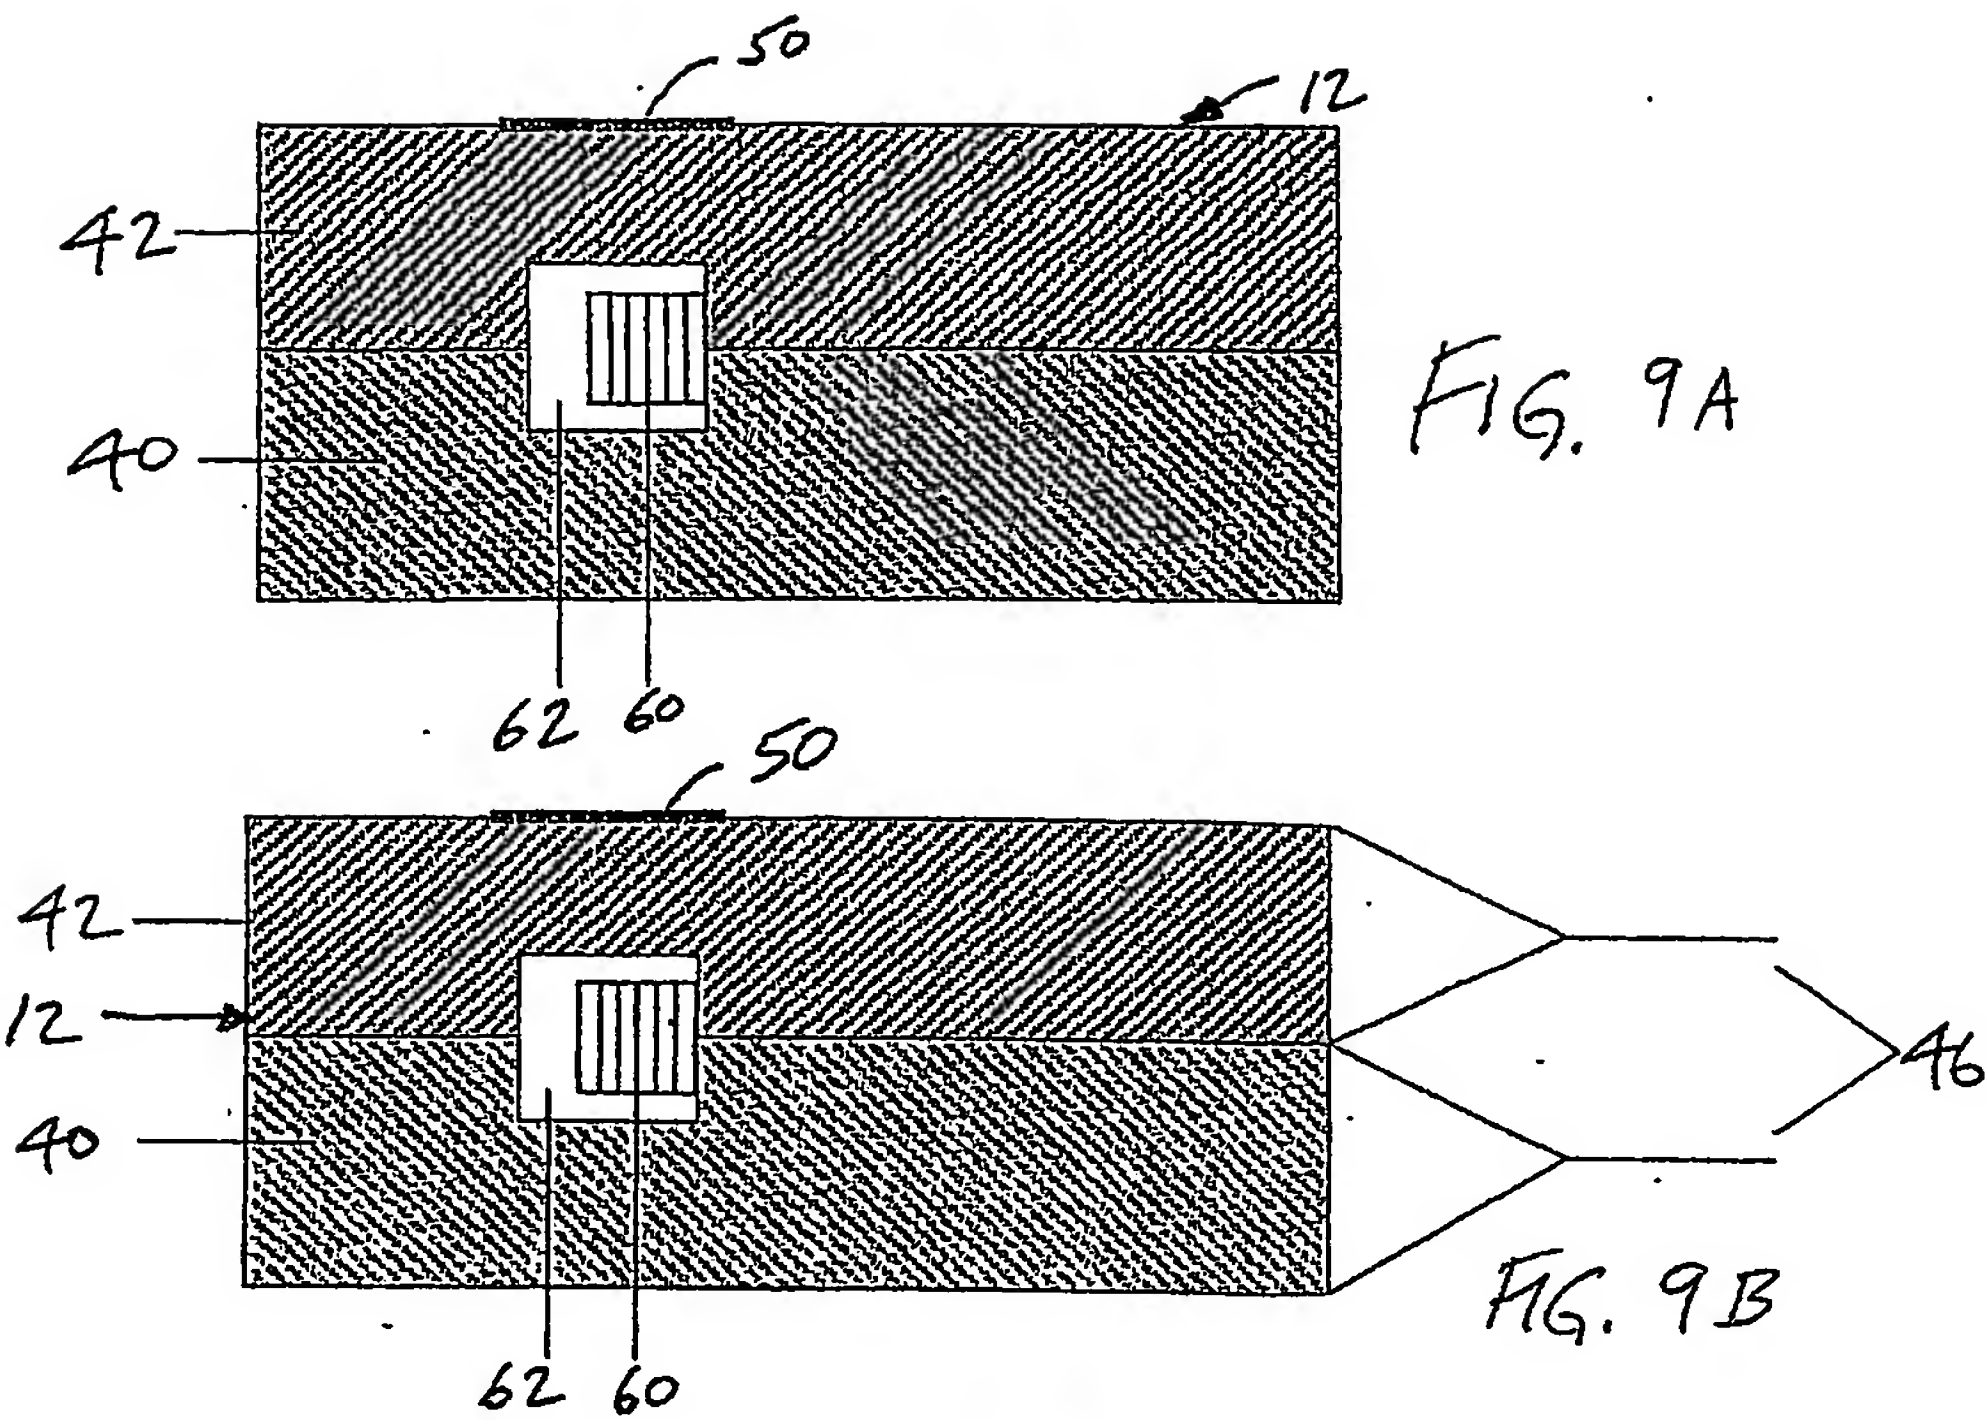

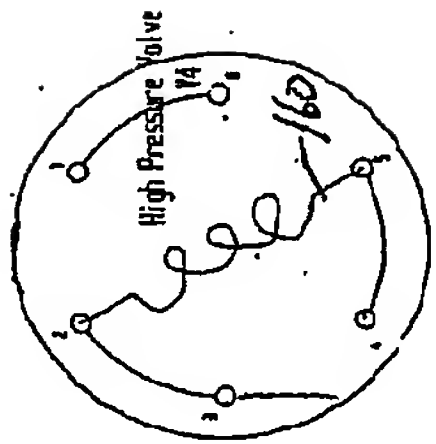

Inject Position

FIG 10B

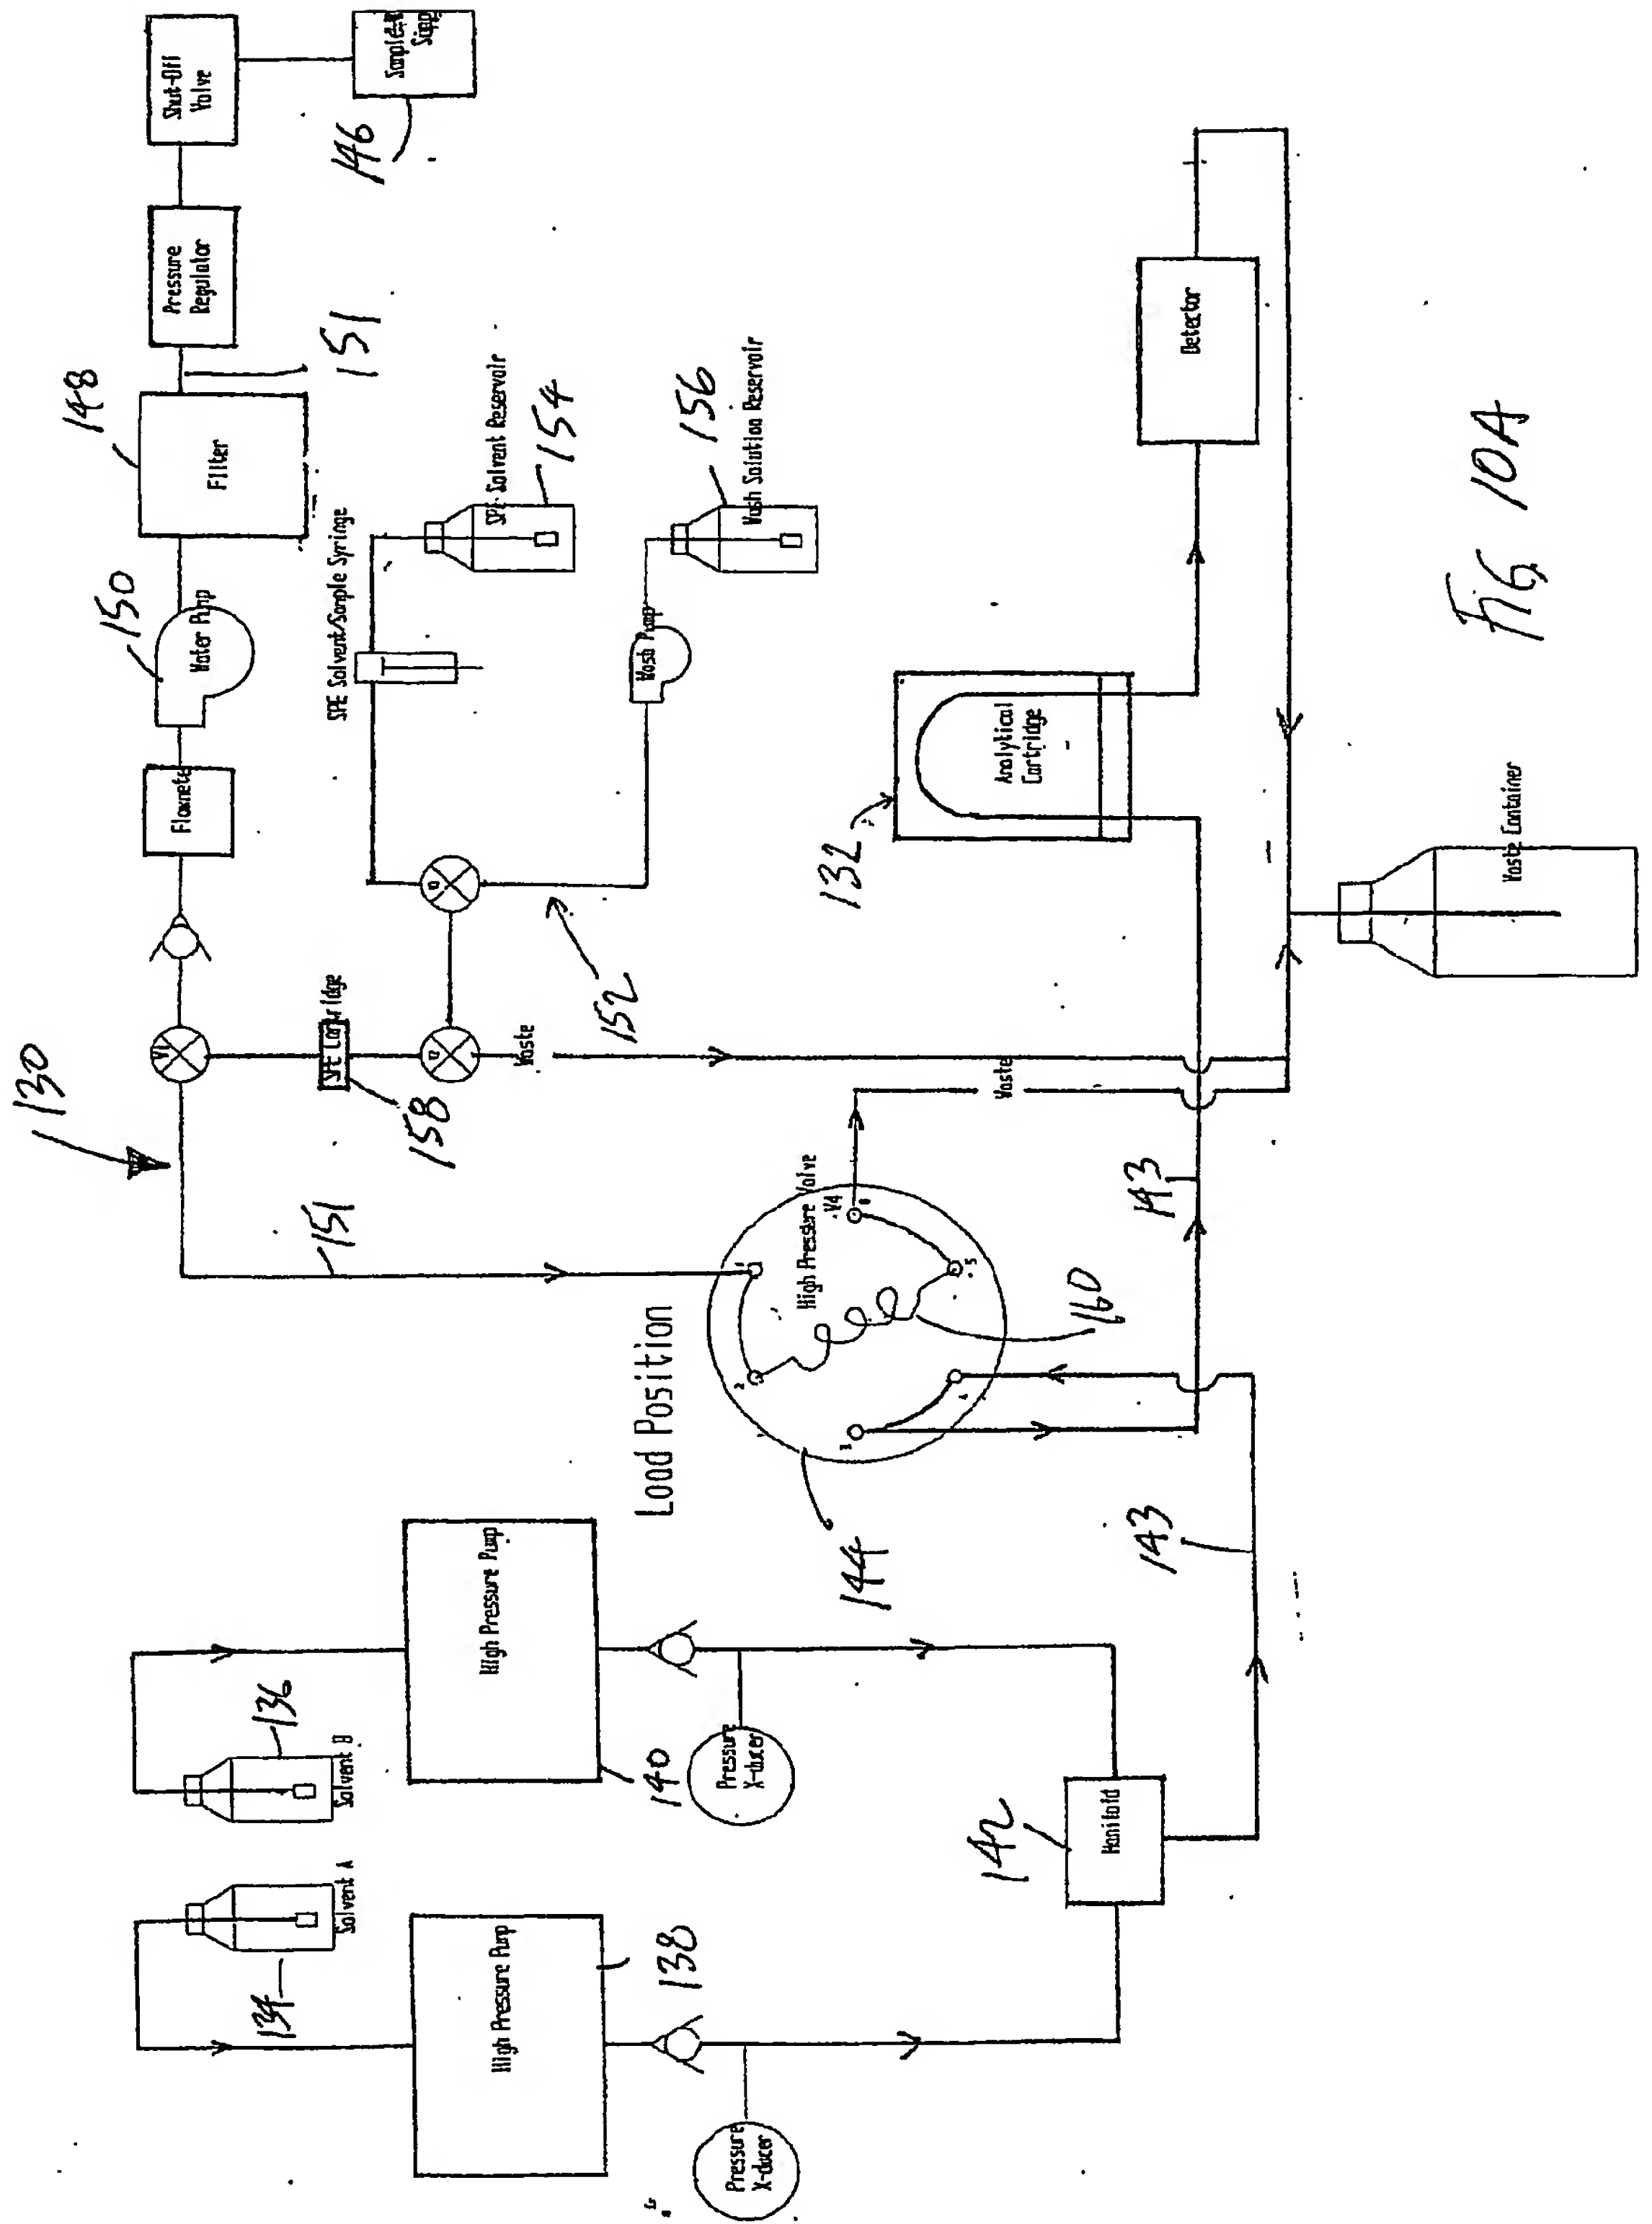


FIG 10A



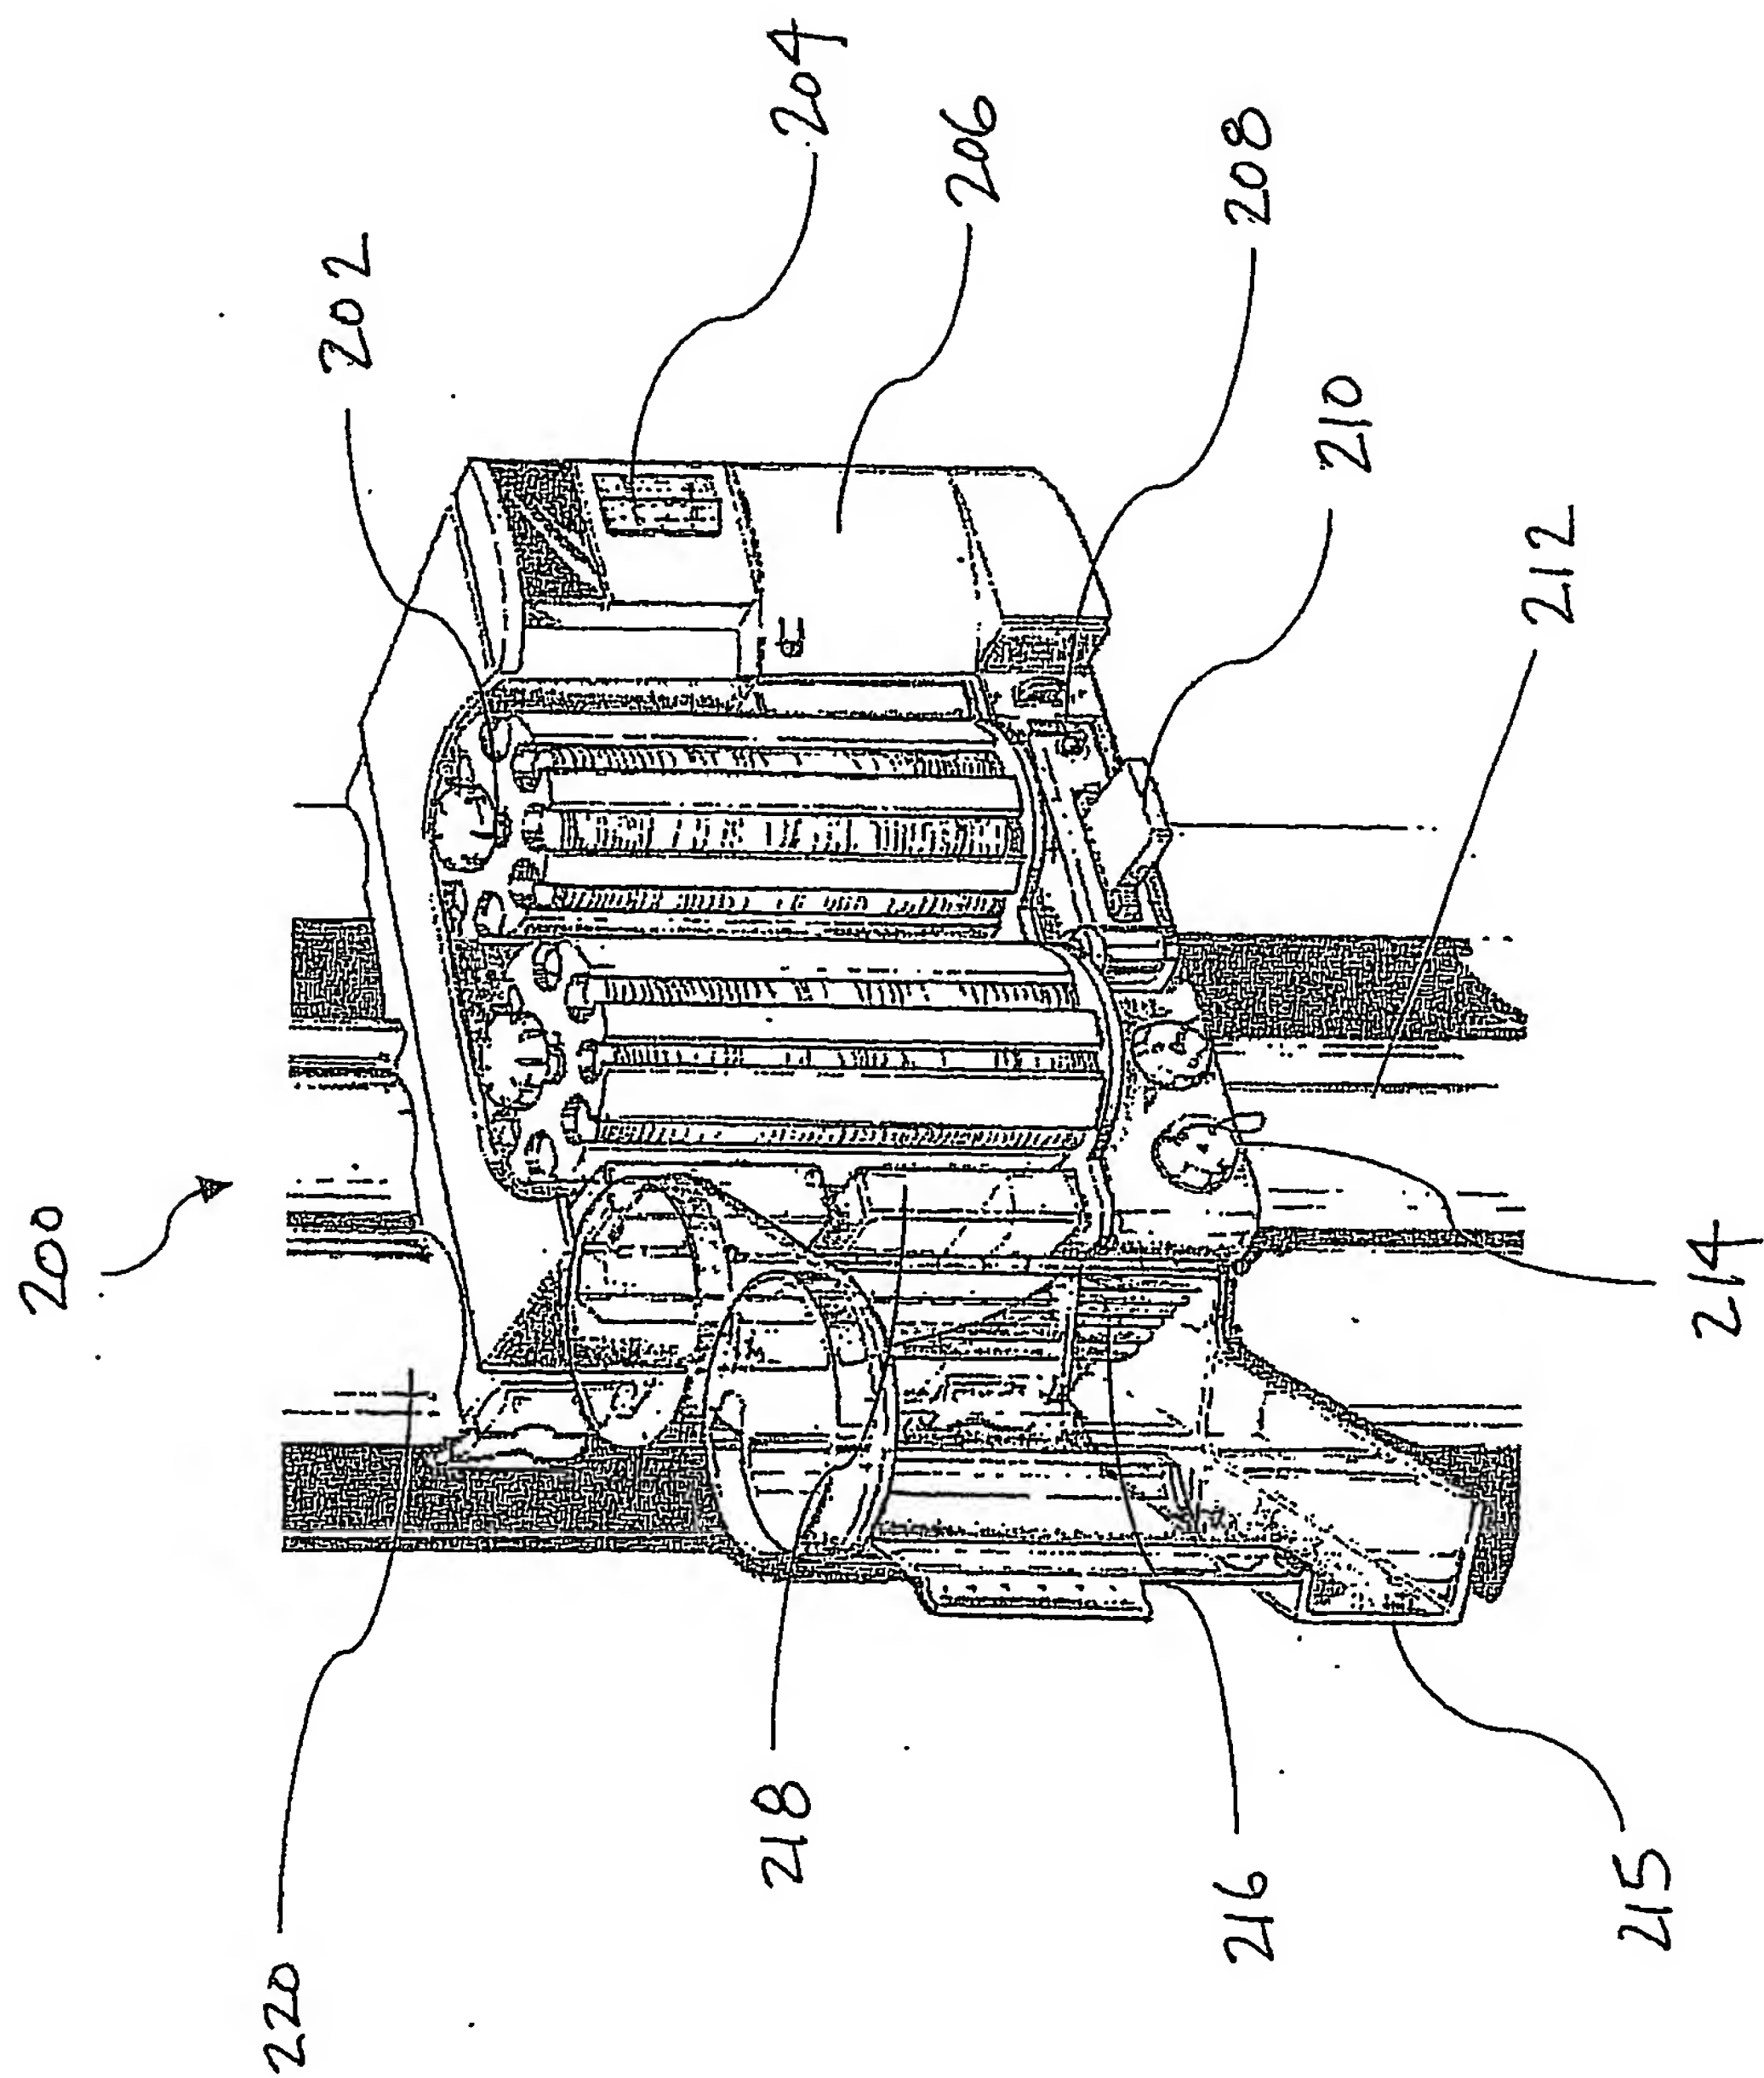


FIG. 11

BEST AVAILABLE COPY

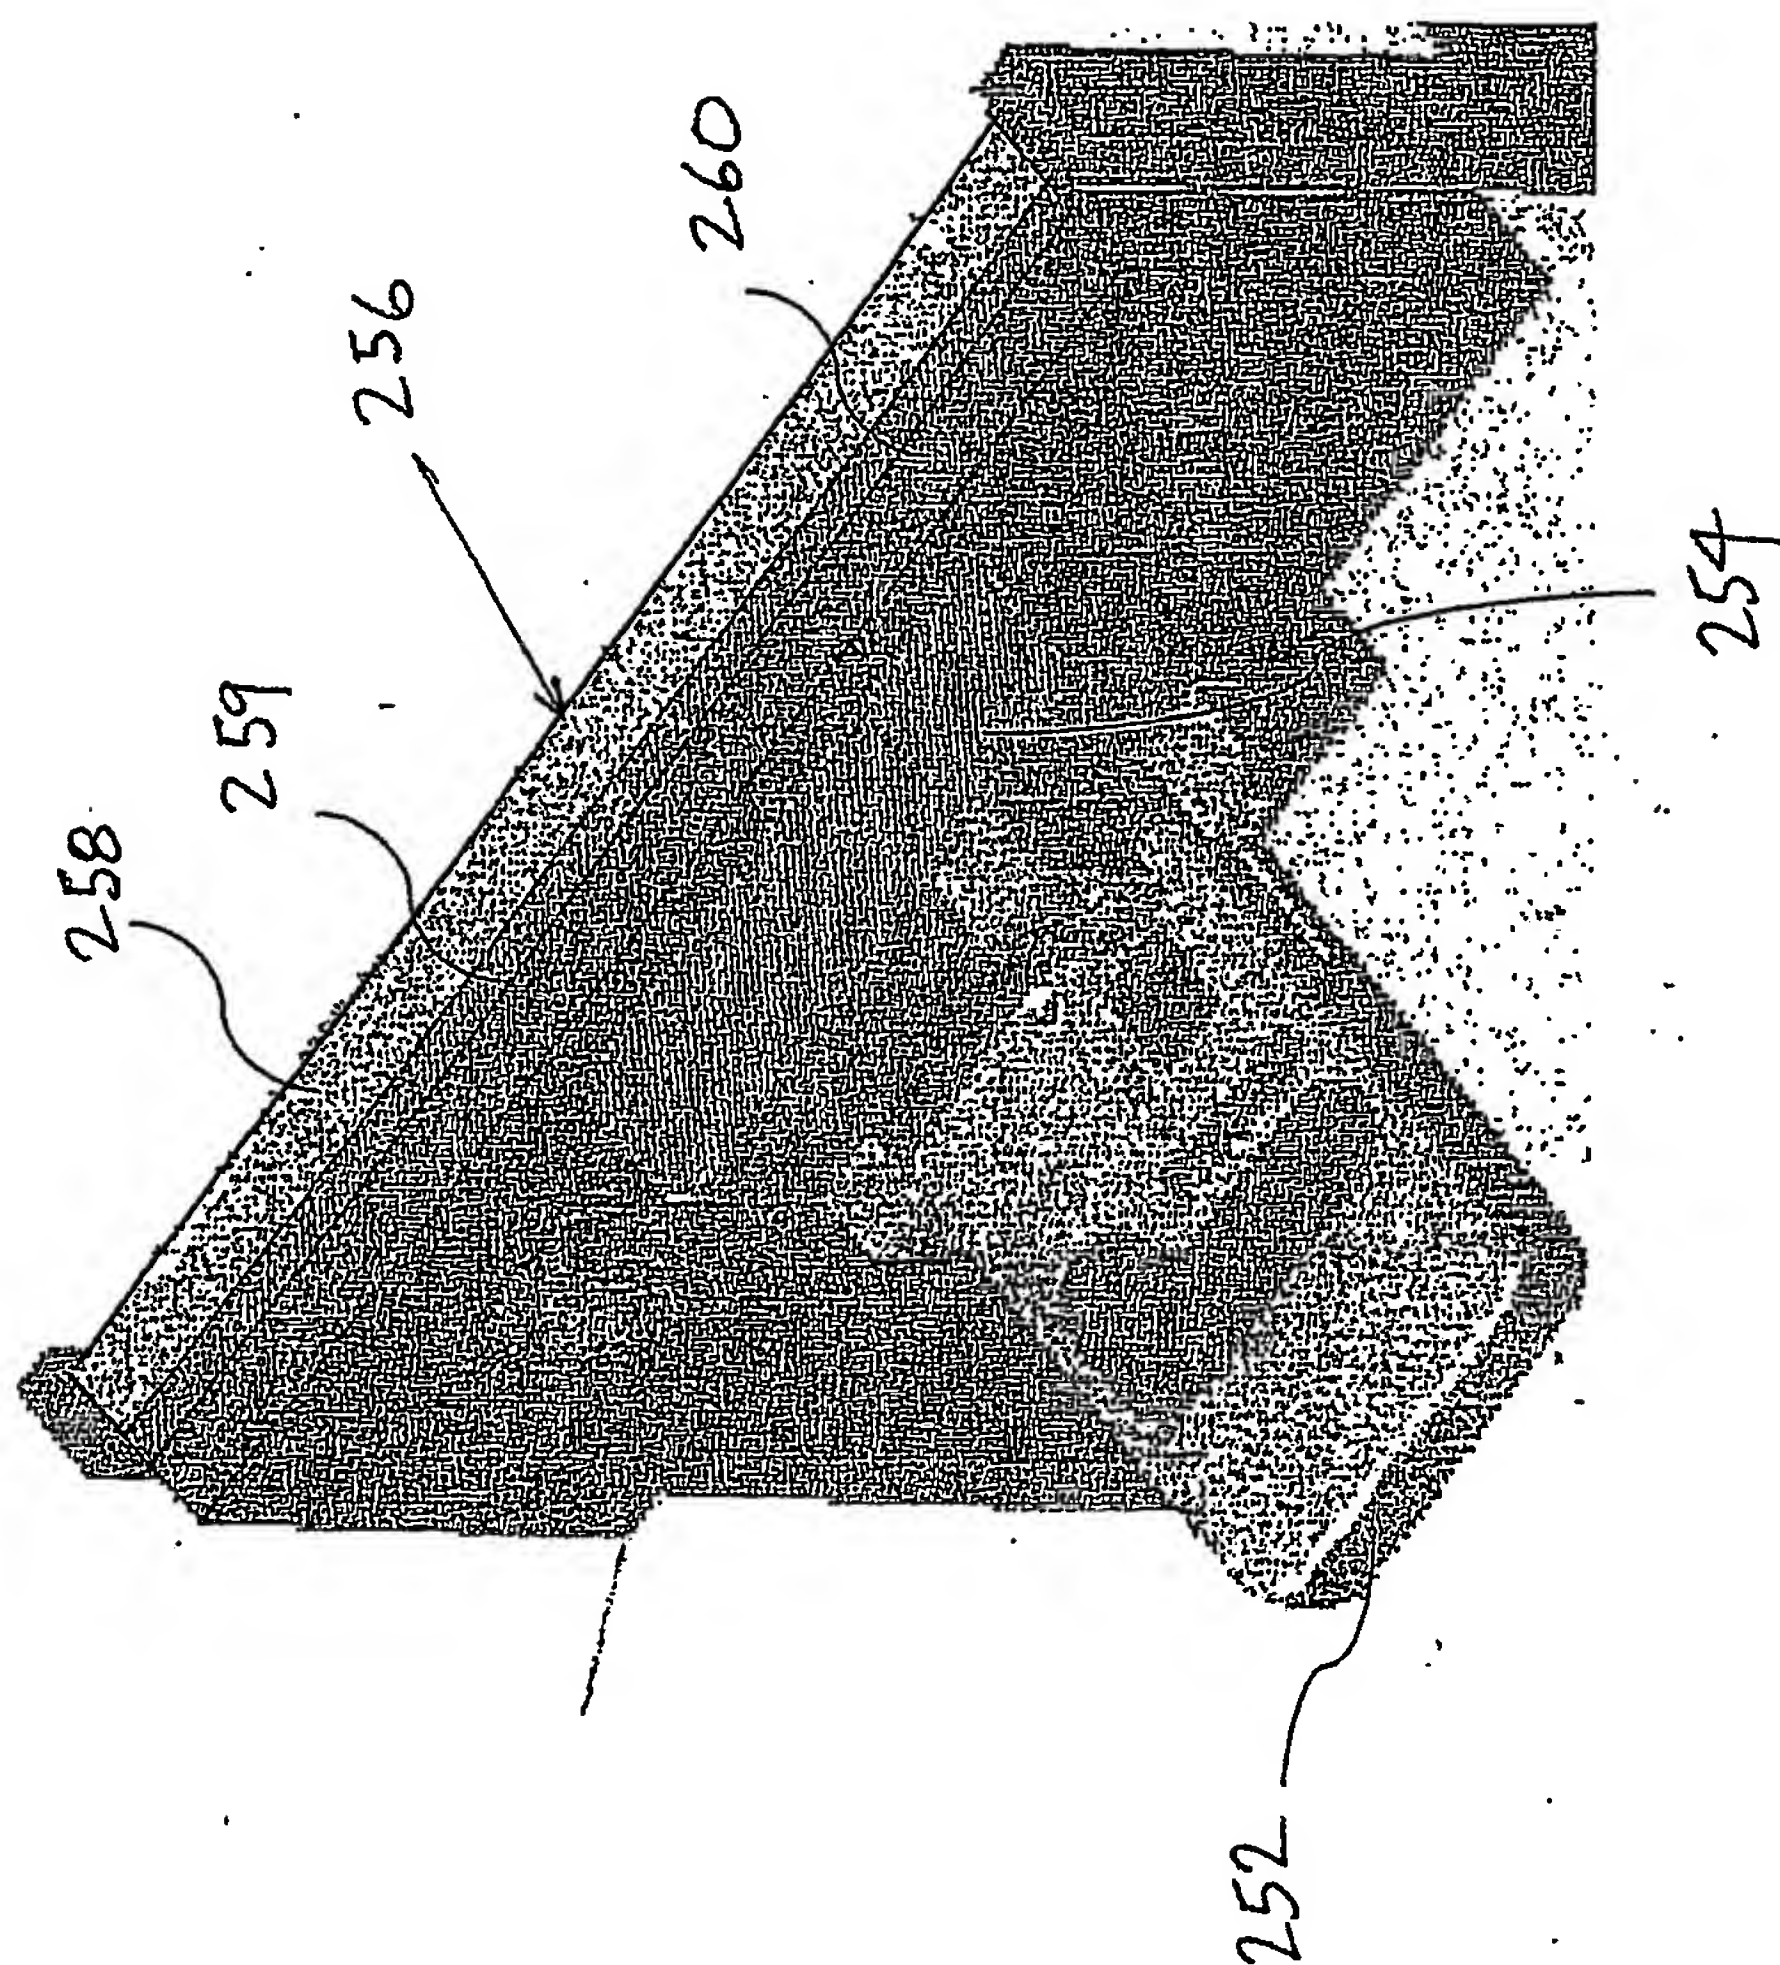


Fig. 12

BEST AVAILABLE COPY

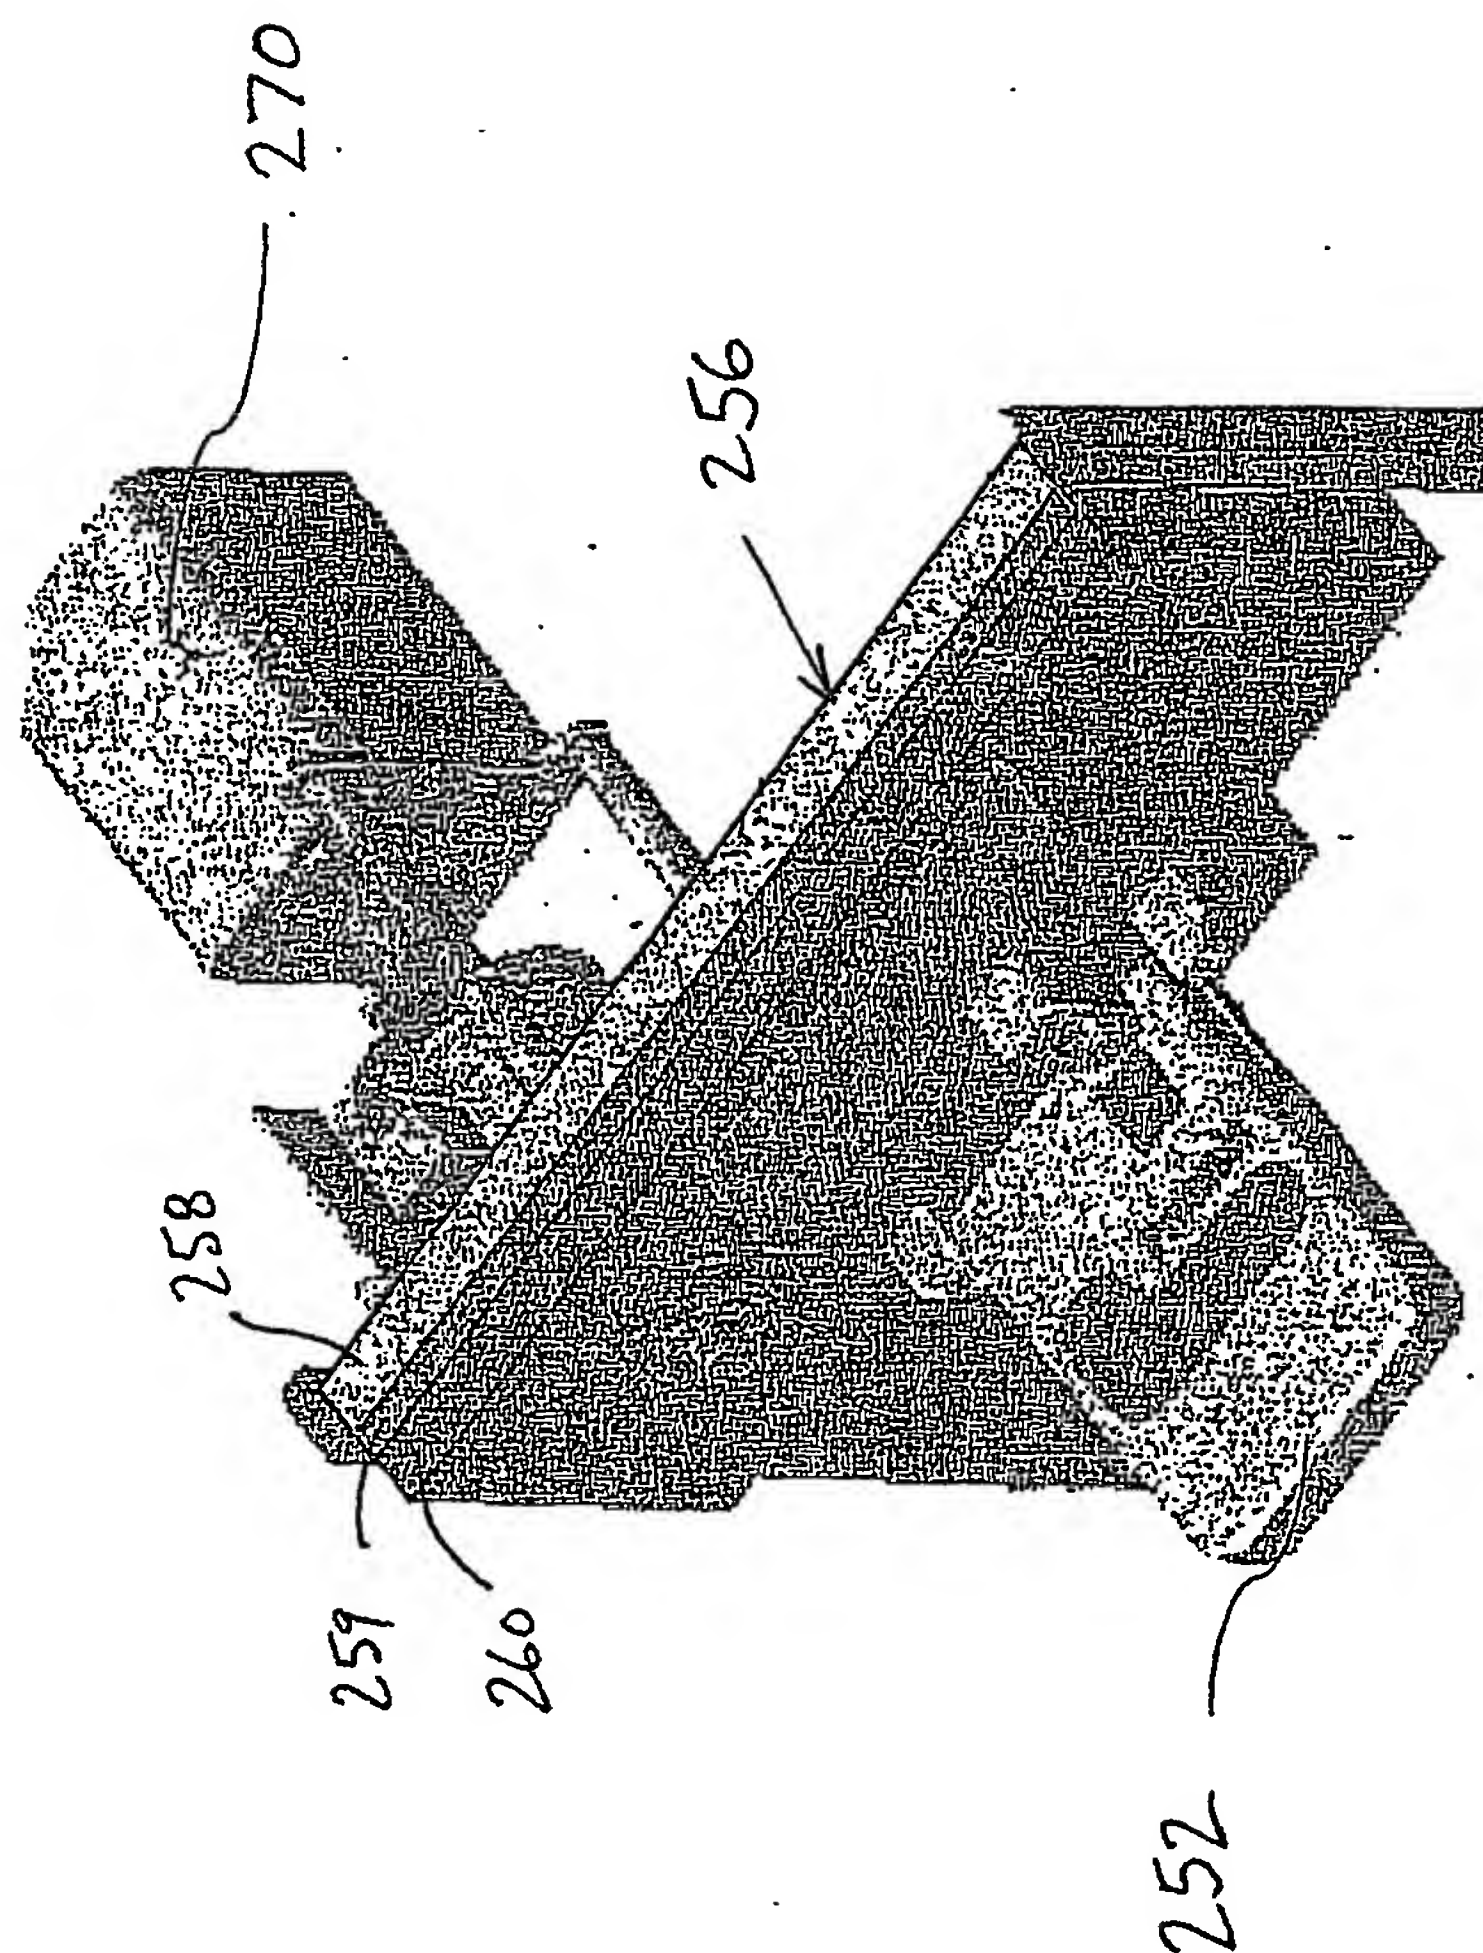


Fig. 13

BEST AVAILABLE COPY

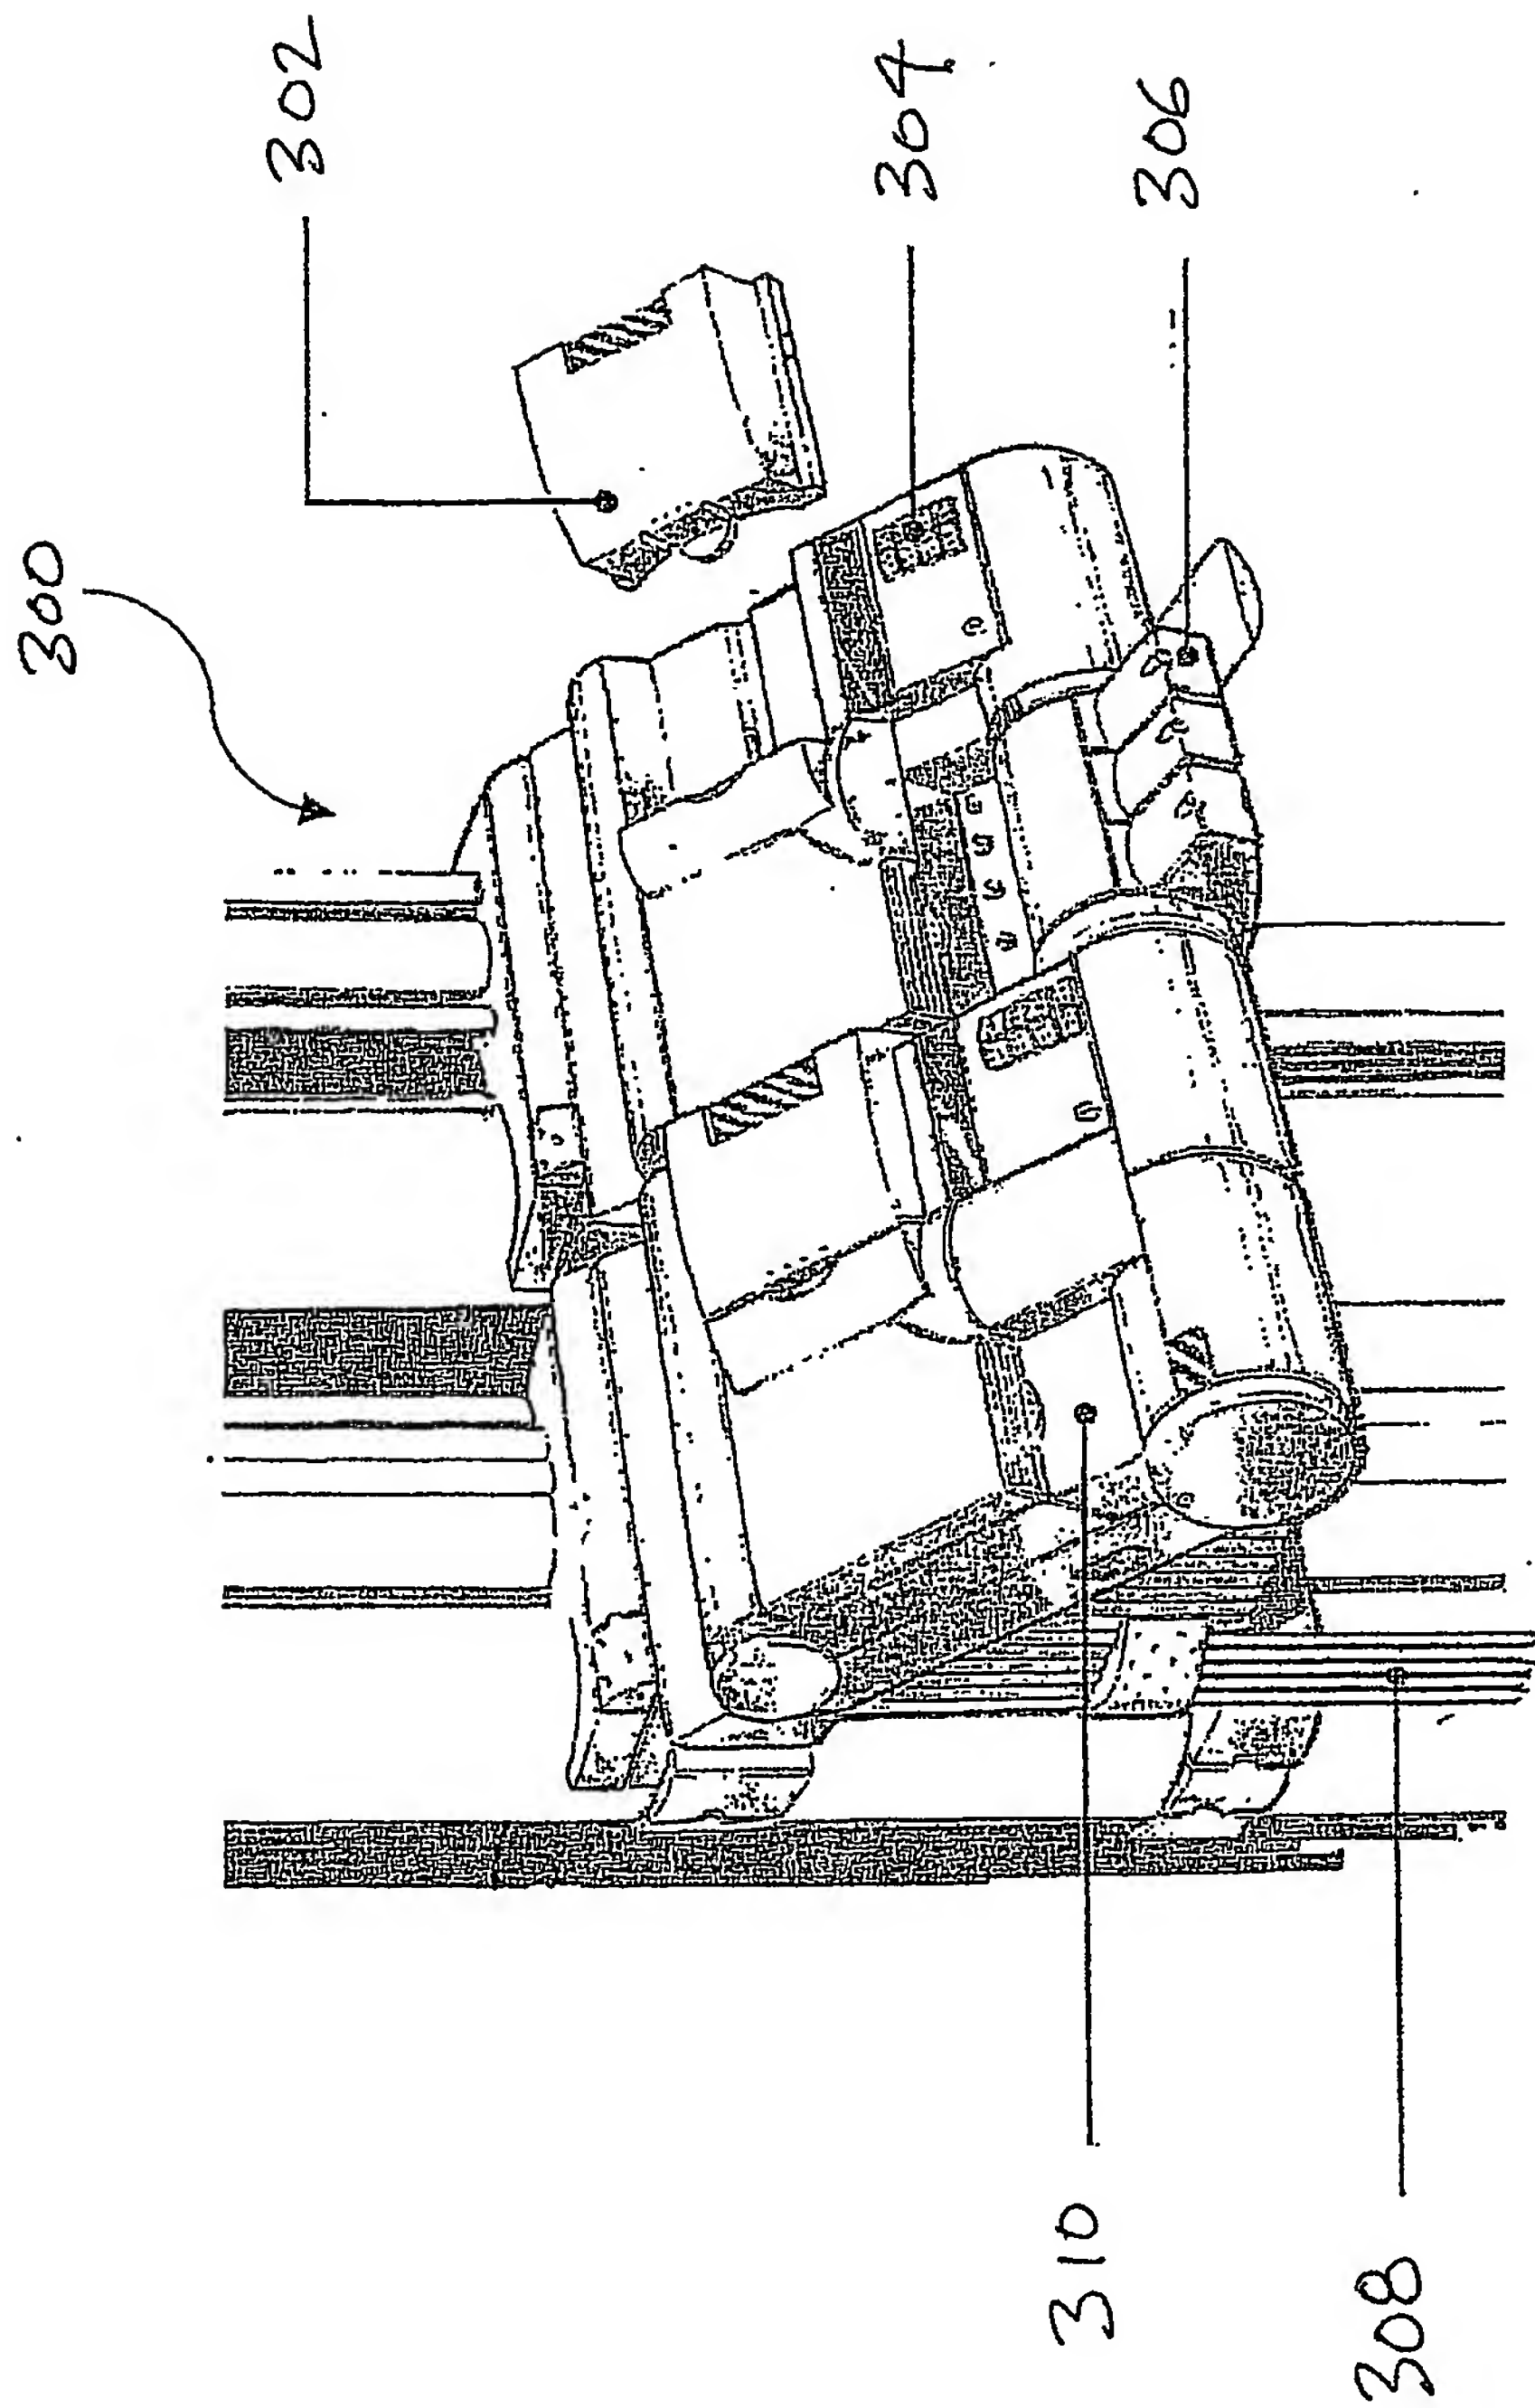


Fig. 14